CUSTOM BARNDOMINIUM HOUSE

DRAWING LIST:

C1 COVER PAGE

A1 FIRST FLOOR PLAN

A2 SECOND FLOOR PLAN

A3 ROOF PLAN

A4 FRONT AND REAR ELEVATION

A5 RIGHT AND LEFT ELEVATION

A6 INTERIOR ELEVATIONS

E1 FIRST FLOOR ELECTRICAL PLAN

E2 SECOND FLOOR ELECTRICAL PLAN

P1 FIRST FLOOR PLUMBING PLAN

P2 SECOND FLOOR PLUMBING PLAN

M1 FIRST FLOOR HVAC PLAN

M2 SECOND FLOOR HVAC PLAN

S1 ROOF FRAMING PLAN

S2 FOUNDATION PLANS3 FOUNDATION DETAIL

INTERIOR BEARING FOOTING


C-TYPICAL COLUMN DETAIL


WALL SECTION

EDGE OF SLAB DETAIL
















ALTHOUGH GREAT EFFORT AND CARE HAVE GONE INTO THE PREPARATION OF THIS HON PLAN, IT IS IMPOSSIBLE TO AFFECT ANY CONTROL OVER THE ACTUAL CONSTRUCTION. FO THAT REASON AND DUE TO THE MANY JURISDICTIONAL DIFFERENCES IN LOCAL BUILDIN CODE REQUIREMENTS AND OTHER LOCAL SEISMC AND WEATHER CONDITIONS, "QUICKSTER BUILDINGS" ASSUMES NO RESPONSIBILITY FOR ANY DAMAGES, MONETARY OR OTHERWIS INCLUDING STRUCTURAL FAILURES DUE TO ANY DEFICIENCIES, OMISSIONS, OR ERRORS THE DESIGN. HOME PLANS ARE GENERAL IN NATURE. IT IS THE RESPONSIBILITY OF THOMAN AND BUILDER TO CONSULT A LOCAL ARCHITECT OR ENGINEER AND TO CHECK WILL LOCAL BUILDING OFFICIALS BEFORE THE START OF CONSTRUCTION. ADDITIONAL ENGINEER NAD BUILDING OFFICIALS BEFOURED TO COMPLY WITH LOCAL BUILDING CODES.






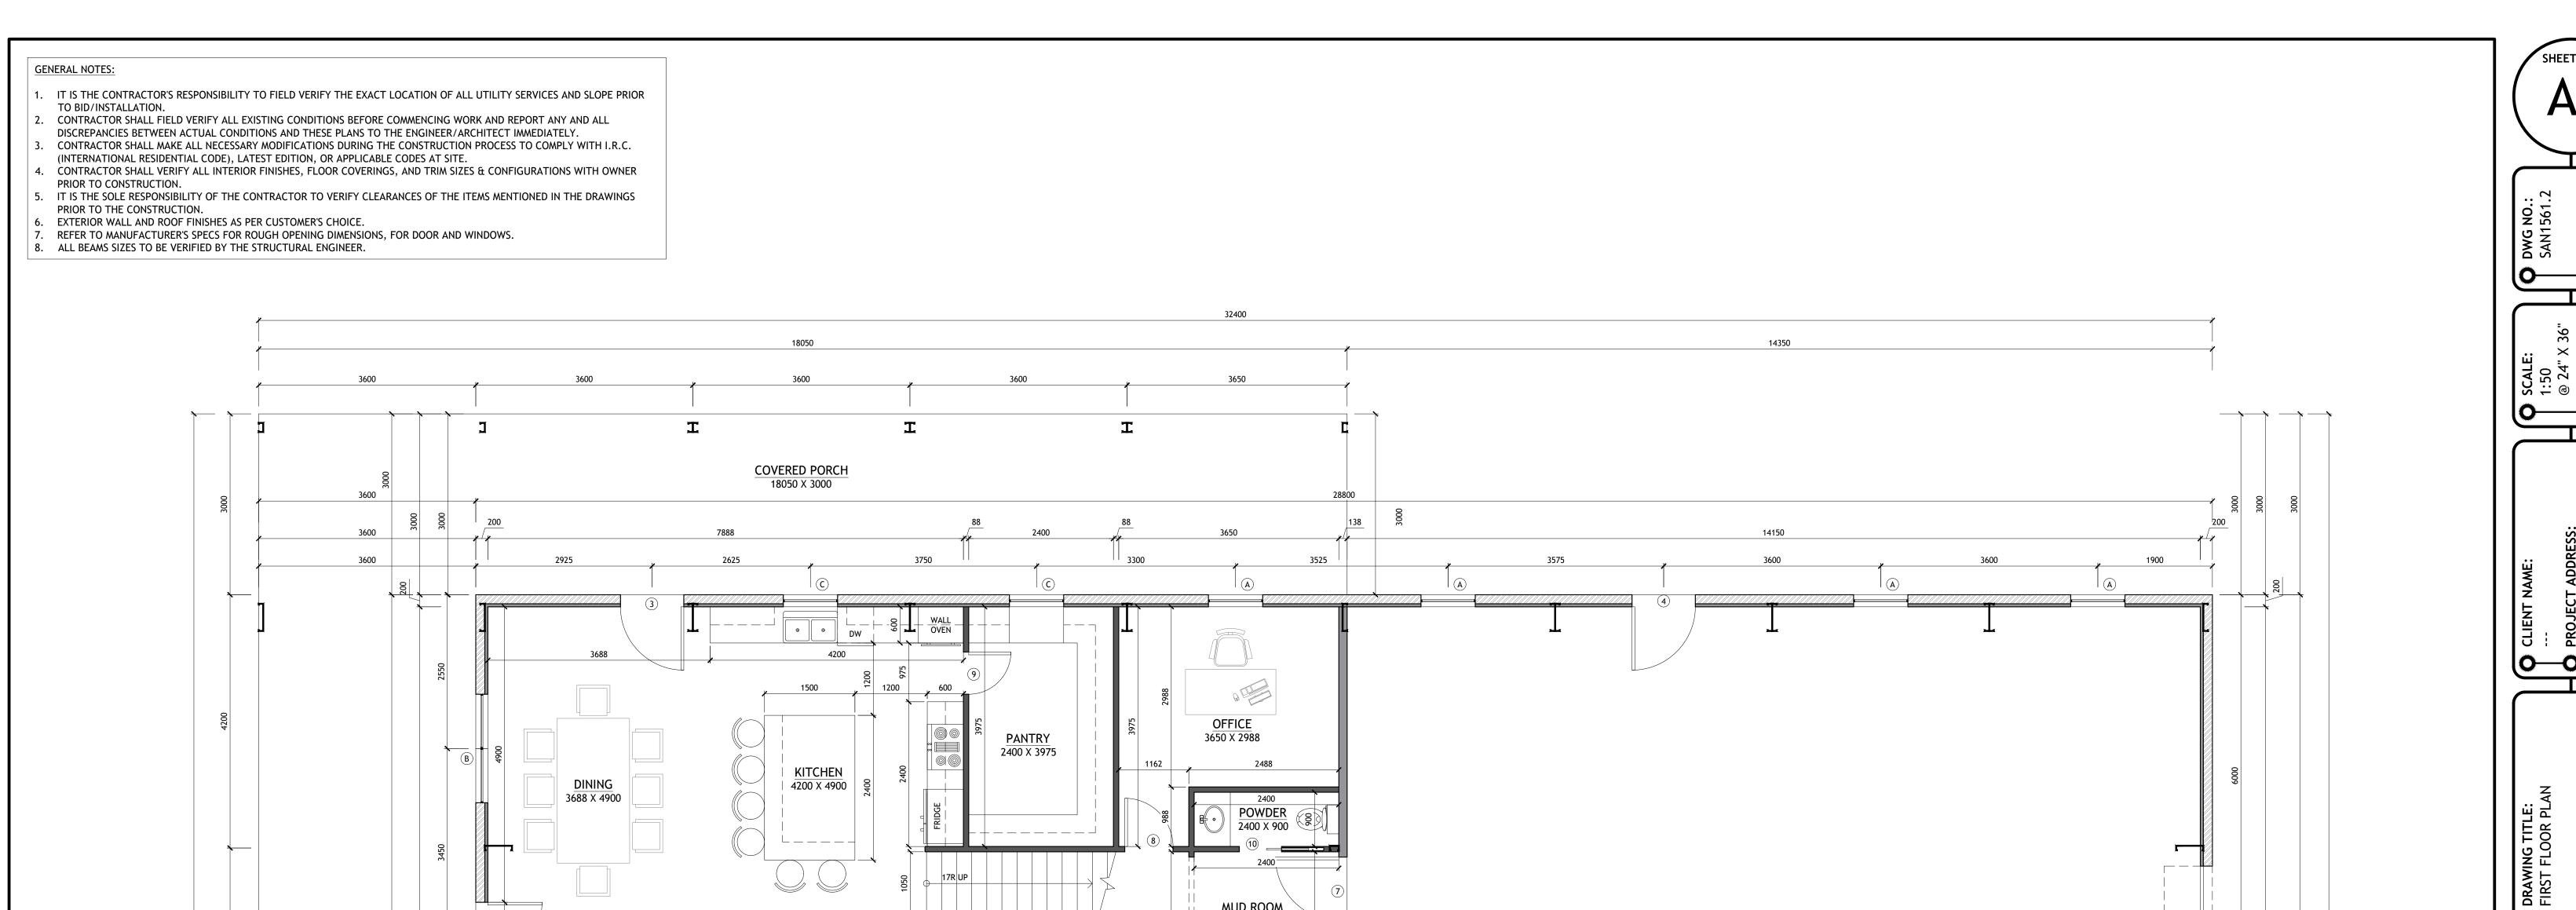

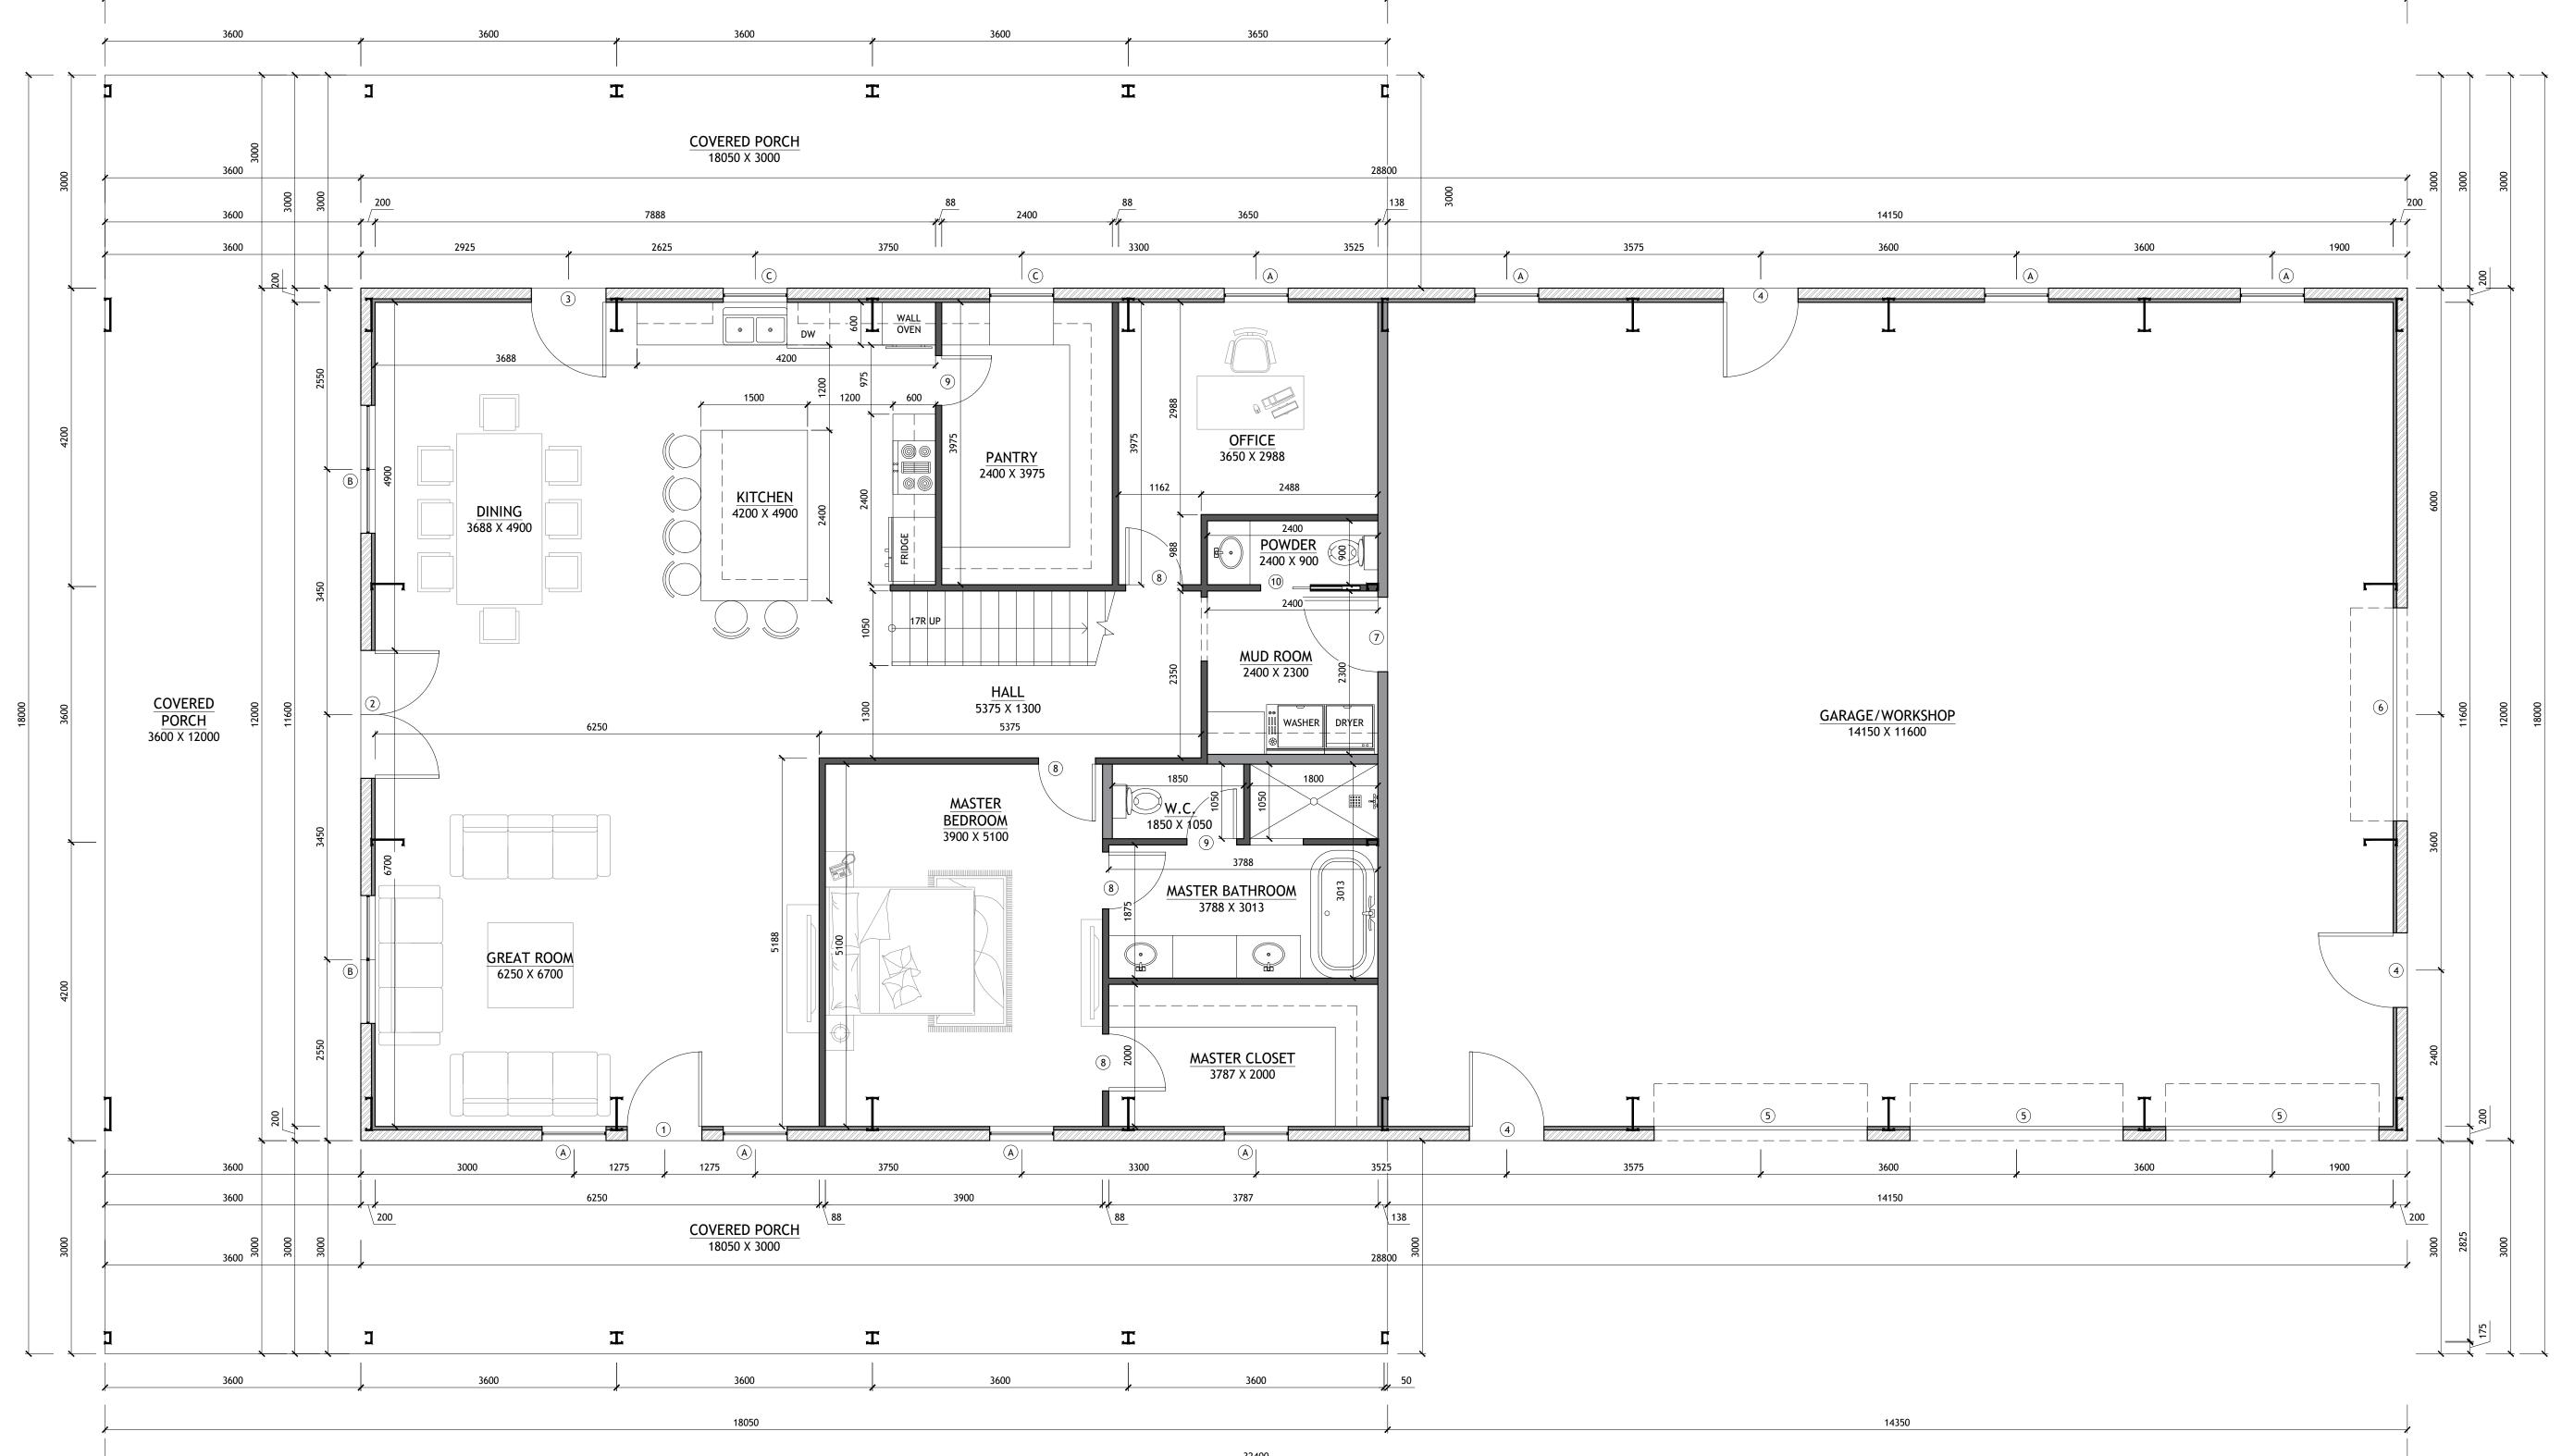



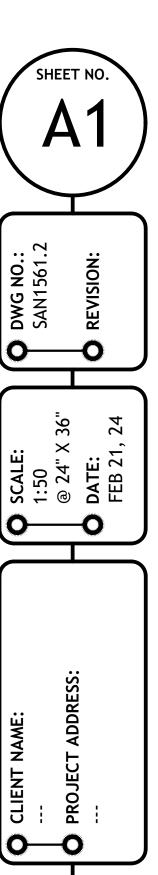

GENERAL NOTES:

1. IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO BID/INSTALLATION.


2. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL

- DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY. CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C.
- (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE. 4. CONTRACTOR SHALL VERIFY ALL INTERIOR FINISHES, FLOOR COVERINGS, AND TRIM SIZES & CONFIGURATIONS WITH OWNER
- PRIOR TO CONSTRUCTION. 5. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY CLEARANCES OF THE ITEMS MENTIONED IN THE DRAWINGS
- PRIOR TO THE CONSTRUCTION. 6. EXTERIOR WALL AND ROOF FINISHES AS PER CUSTOMER'S CHOICE.
- 7. REFER TO MANUFACTURER'S SPECS FOR ROUGH OPENING DIMENSIONS, FOR DOOR AND WINDOWS.
- 8. ALL BEAMS SIZES TO BE VERIFIED BY THE STRUCTURAL ENGINEER.

DOOR SCHEDULE					
	WIDTH	HEIGHT	QTY.	DESCRIPTION	
1	1050	2040	1	FRONT DOOR	
2	1800	2040	2	DOUBLE FRENCH DOOR	
3	1050	2040	1	FRENCH DOOR	
4	1050	2040	3	SOLID DOOR	
5	3000	2040	3	ROLL UP DOOR	
6	3000	2040	1	ROLL UP DOOR	
7	1050	2040	1	FIRE RATED DOOR	
8	820	2040	9	HOLLOW CORE	
9	720	2040	2	HOLLOW CORE	
10	720	2040	9	POCKET DOOR	


	WINDOW SCHEDULE					
	WIDTH	HEIGHT	QTY.	DESCRIPTION		
(A)	900	1500	12	SINGLE HUNG		
\bigcirc B	1800	1500	6	SINGLE HUNG (DOU		
<u>C</u>	900	1200	2	SINGLE HUNG		
D	1500	600	2	TRANSOM		
E	3000	600	7	TRANSOM		
F	2400	600	2	TRANSOM		
				•		


AREA CALCULATION	NC
FIRST FLOOR	
LIVING AREA:	179 SQM.
GARAGE/WORKSHOP:	177 SQM.
COVERED PORCH:	156 SQM.
SECOND FLOOR	
LIVING AREA:	179 SQM.
DECK:	44 SQM.
TOTAL LIVING AREA:	358 SQM.

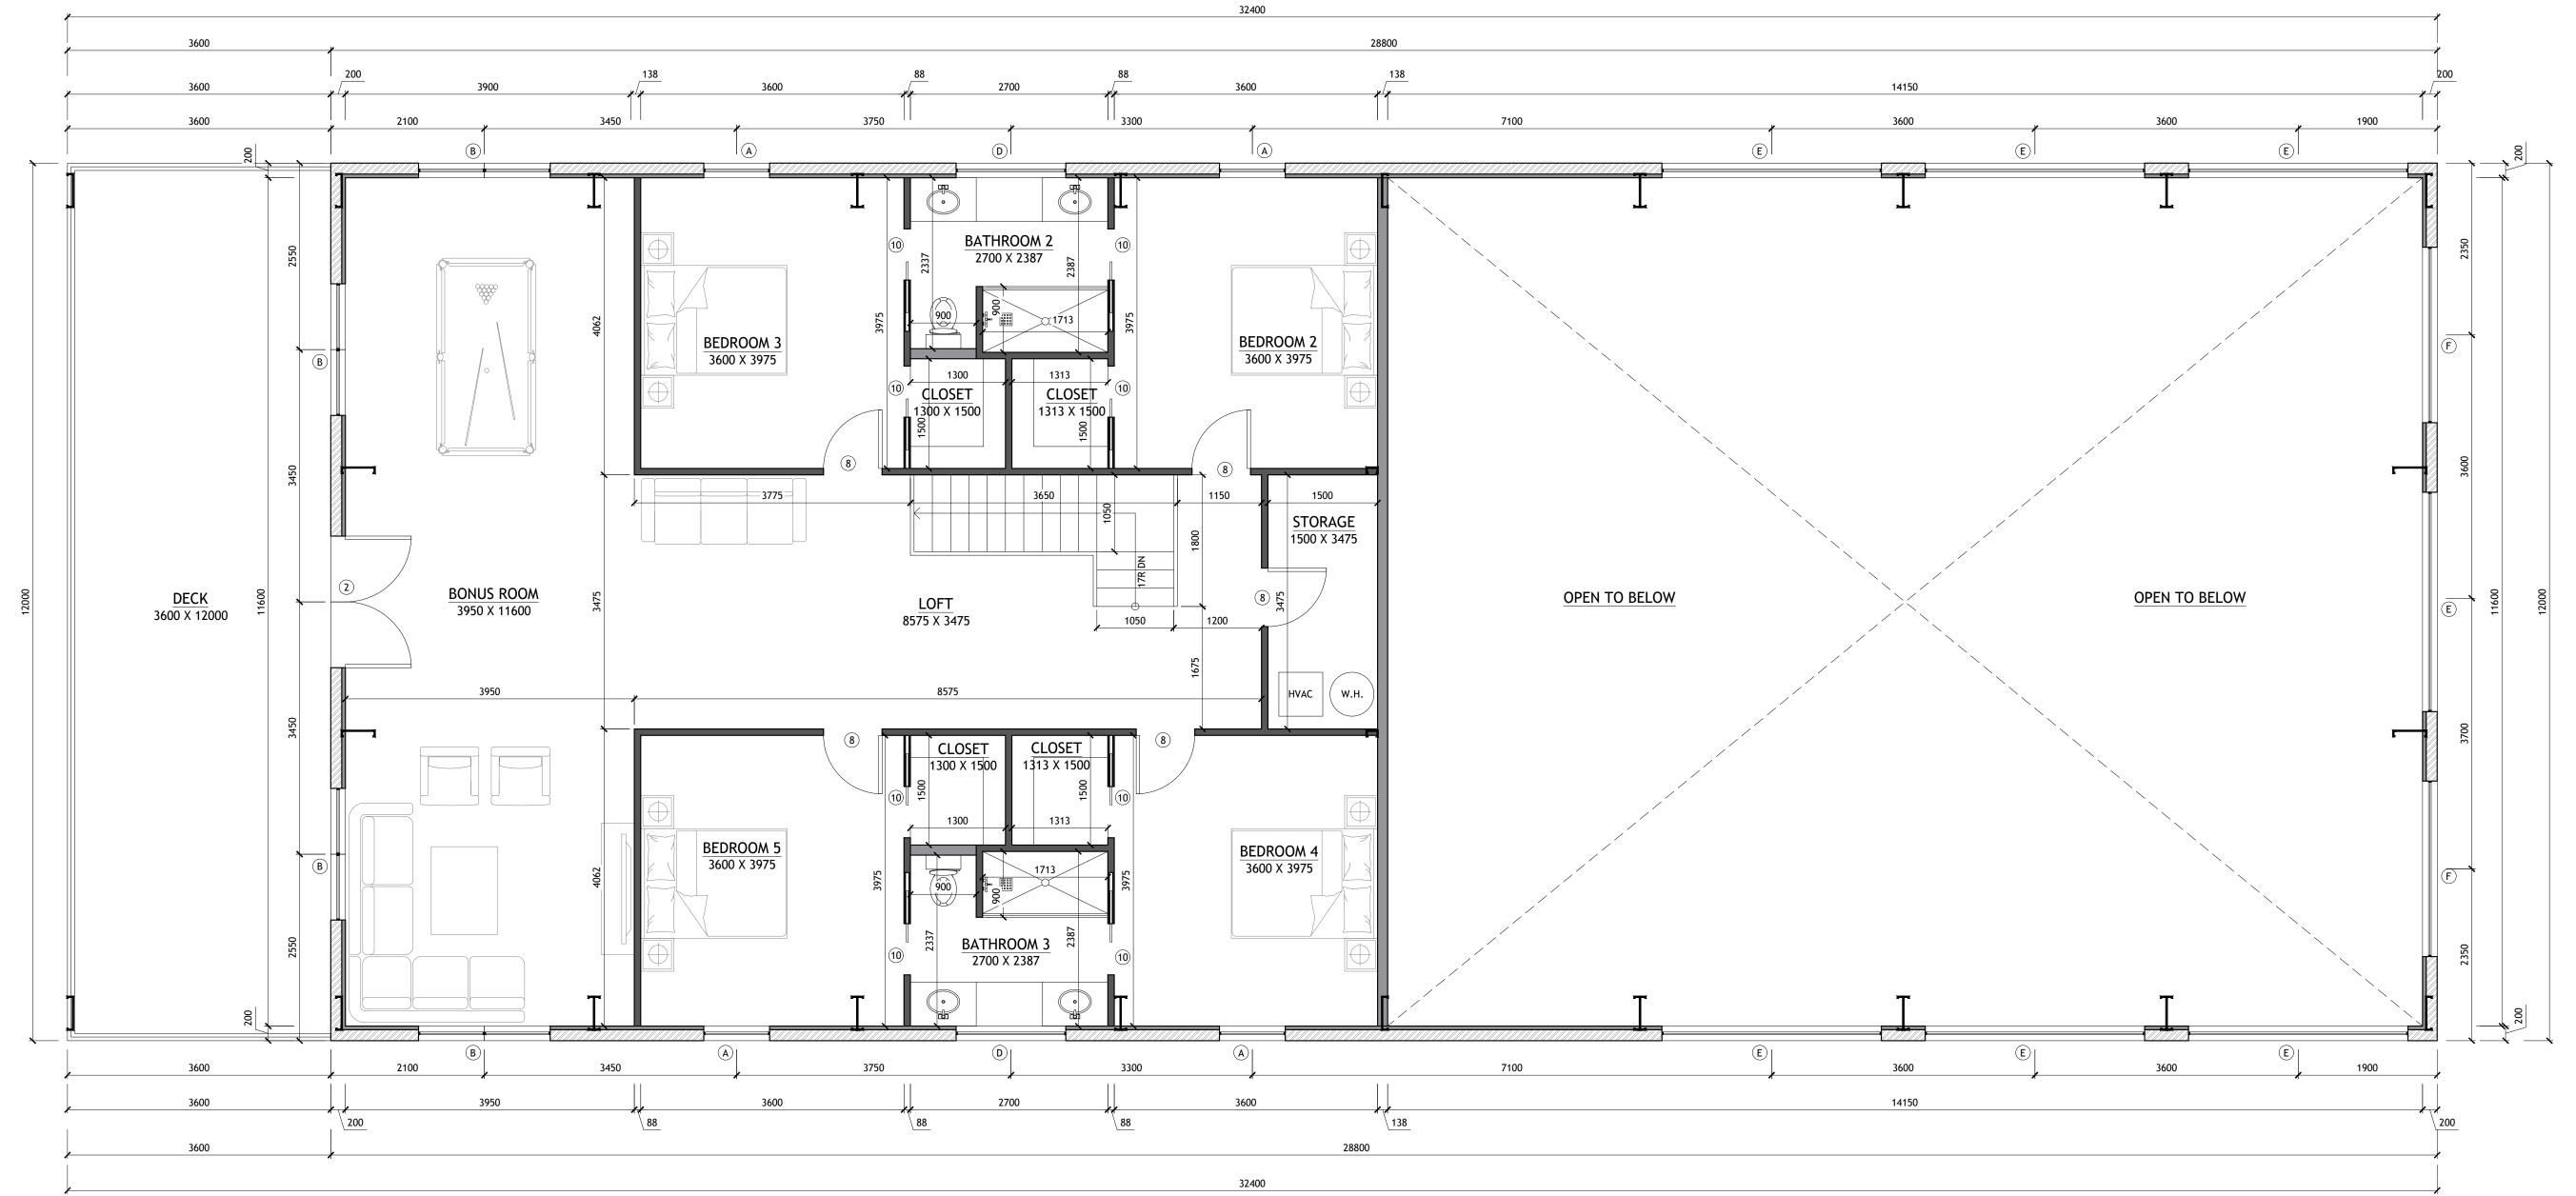




















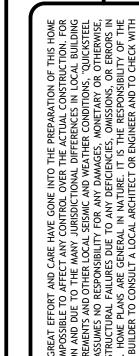







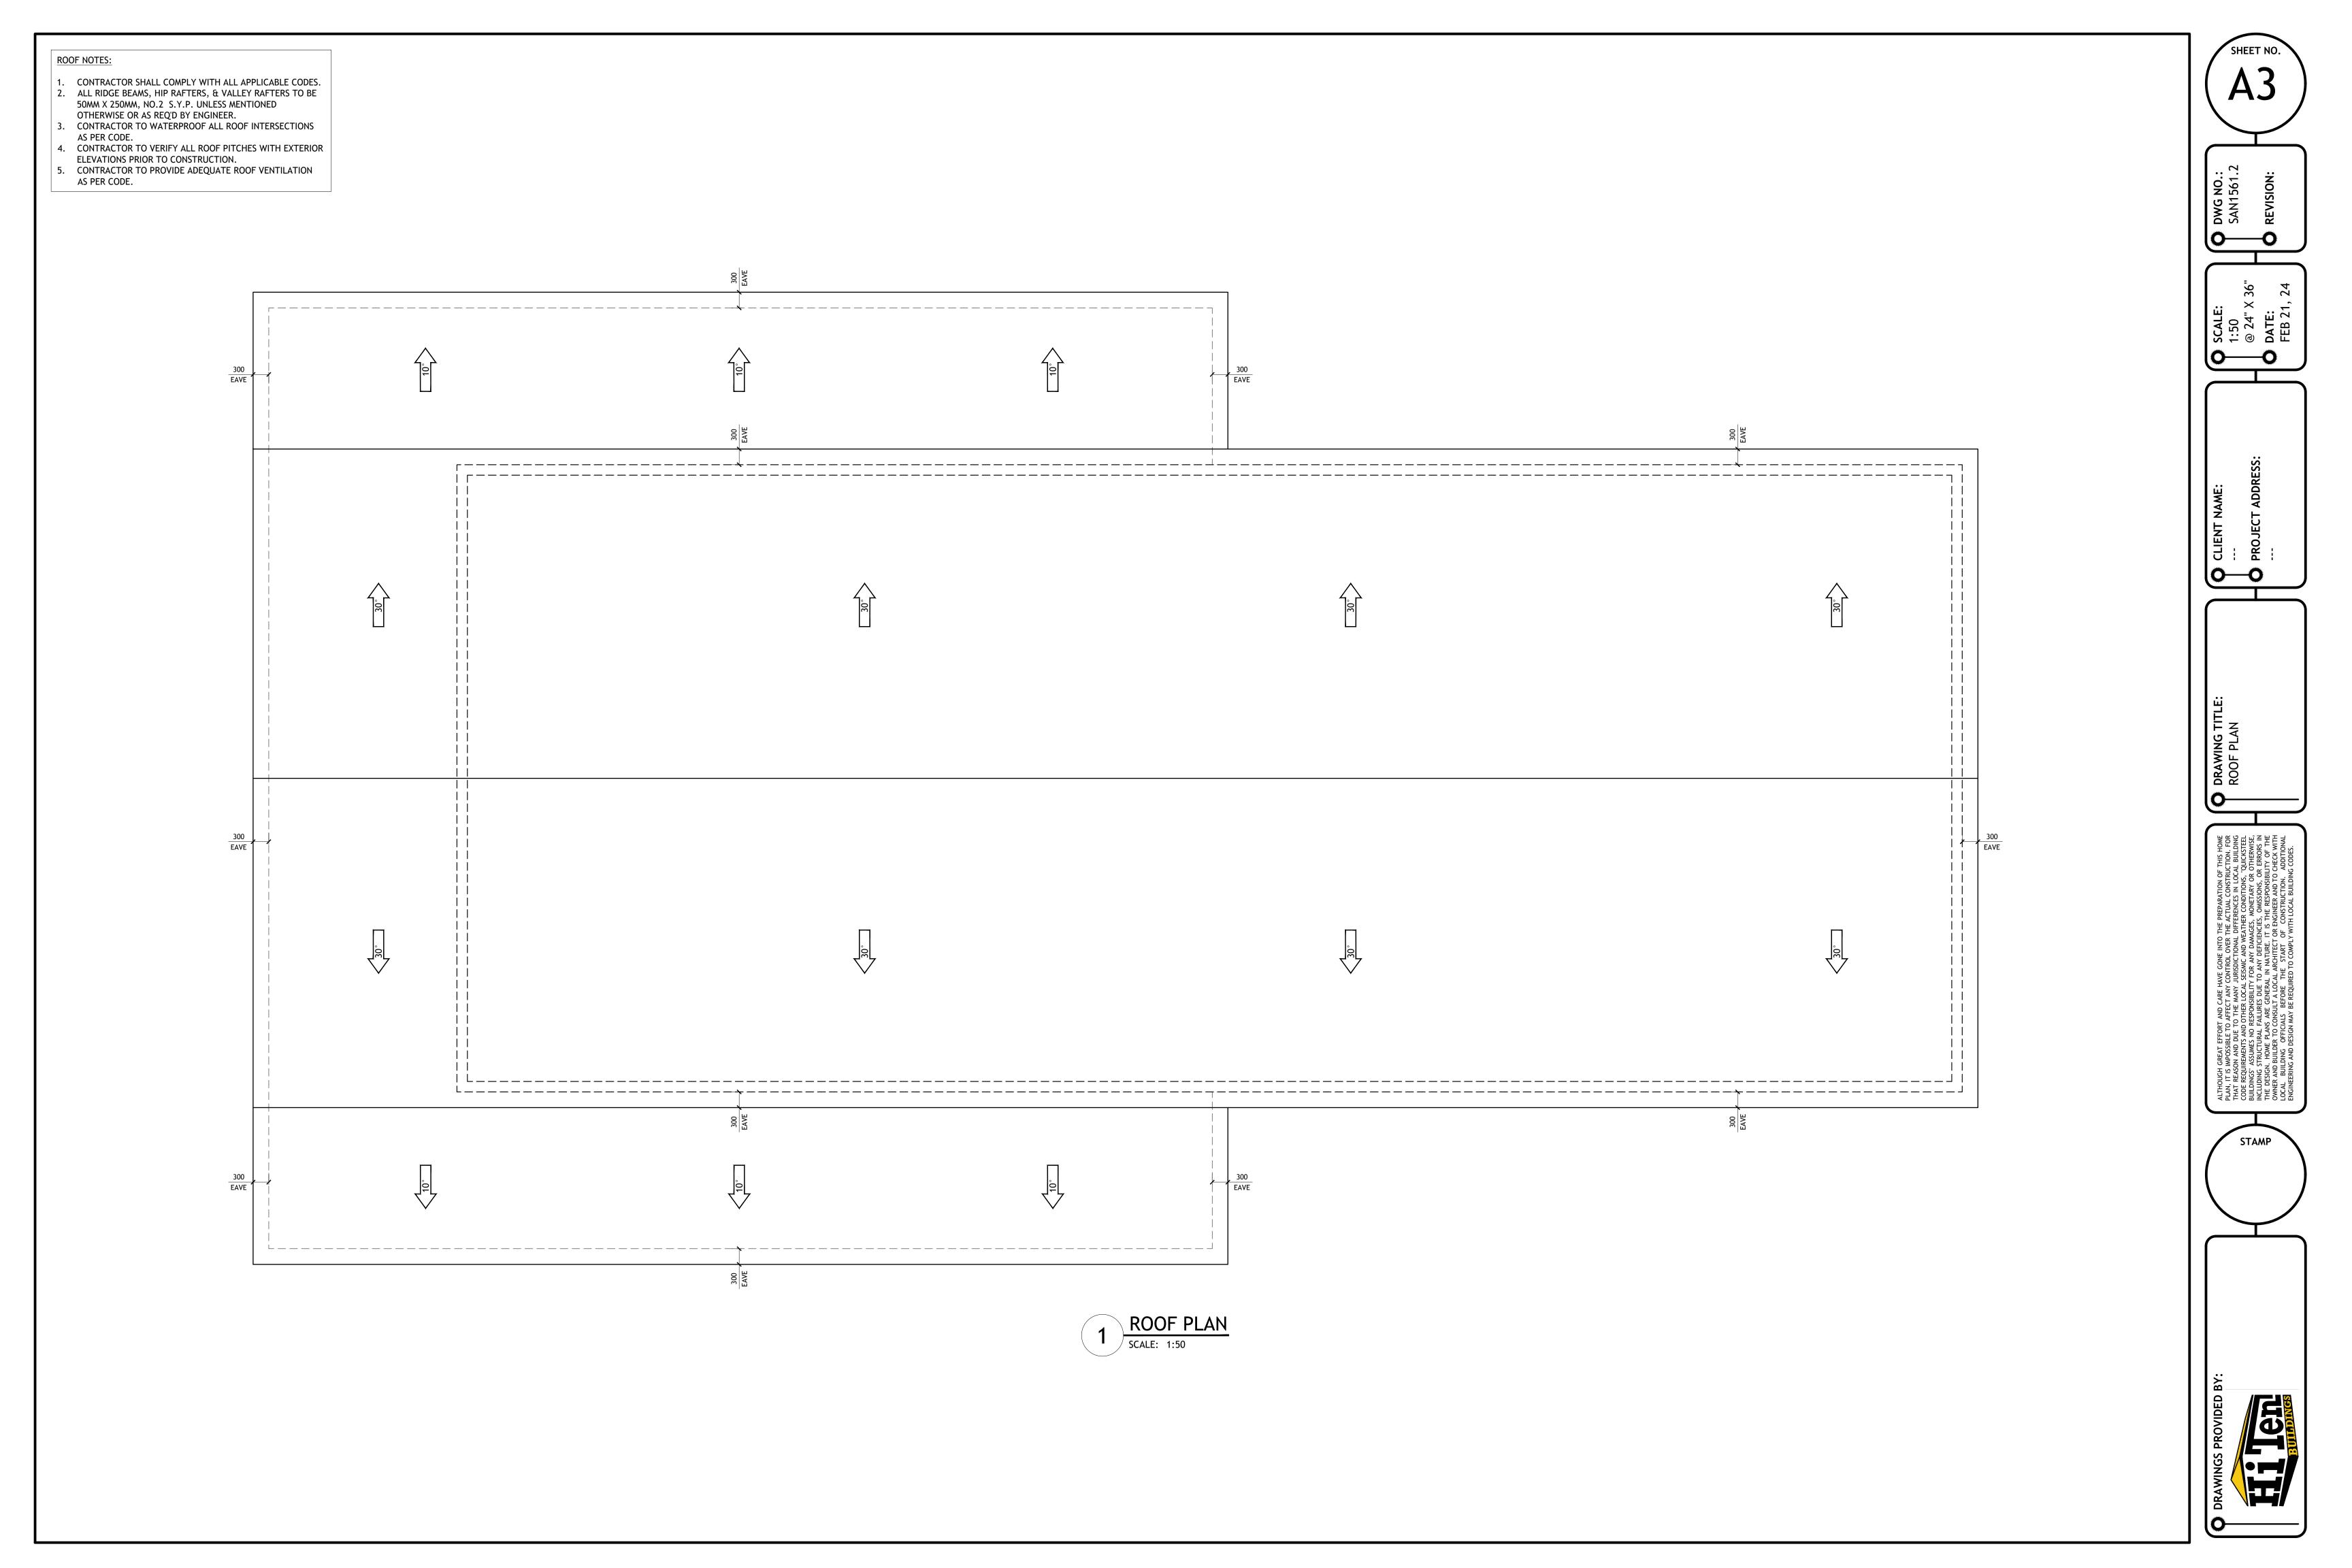

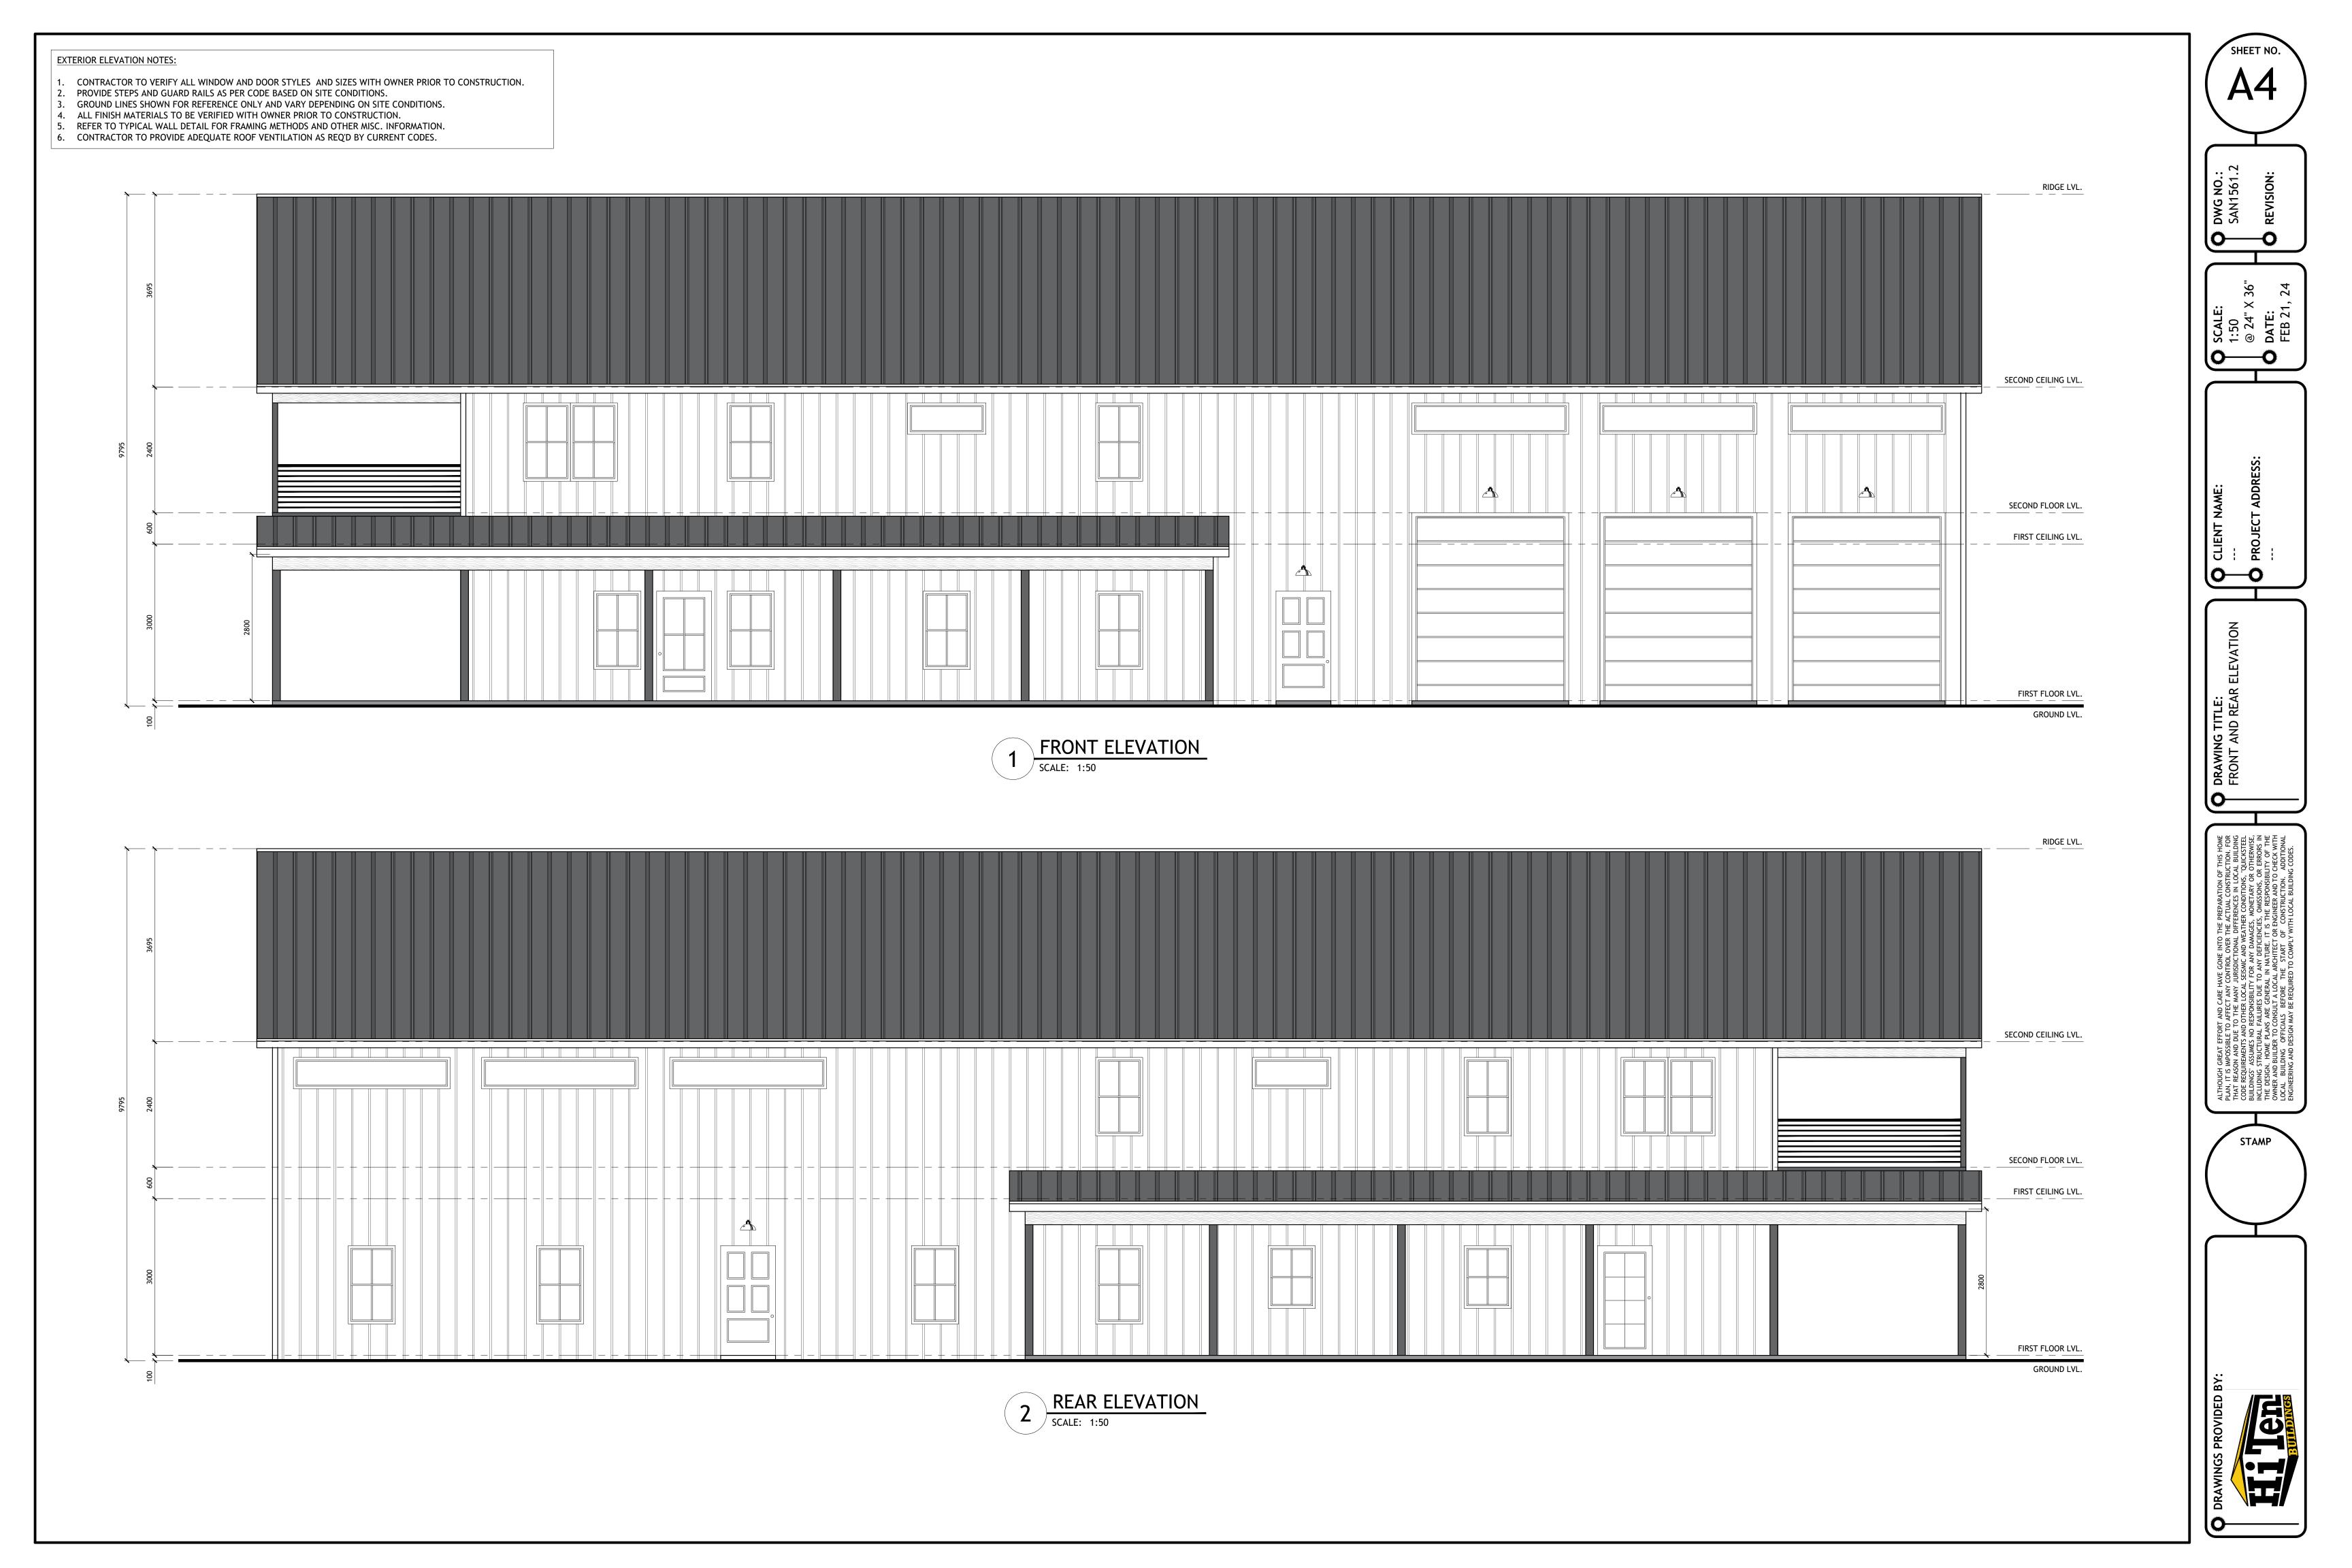

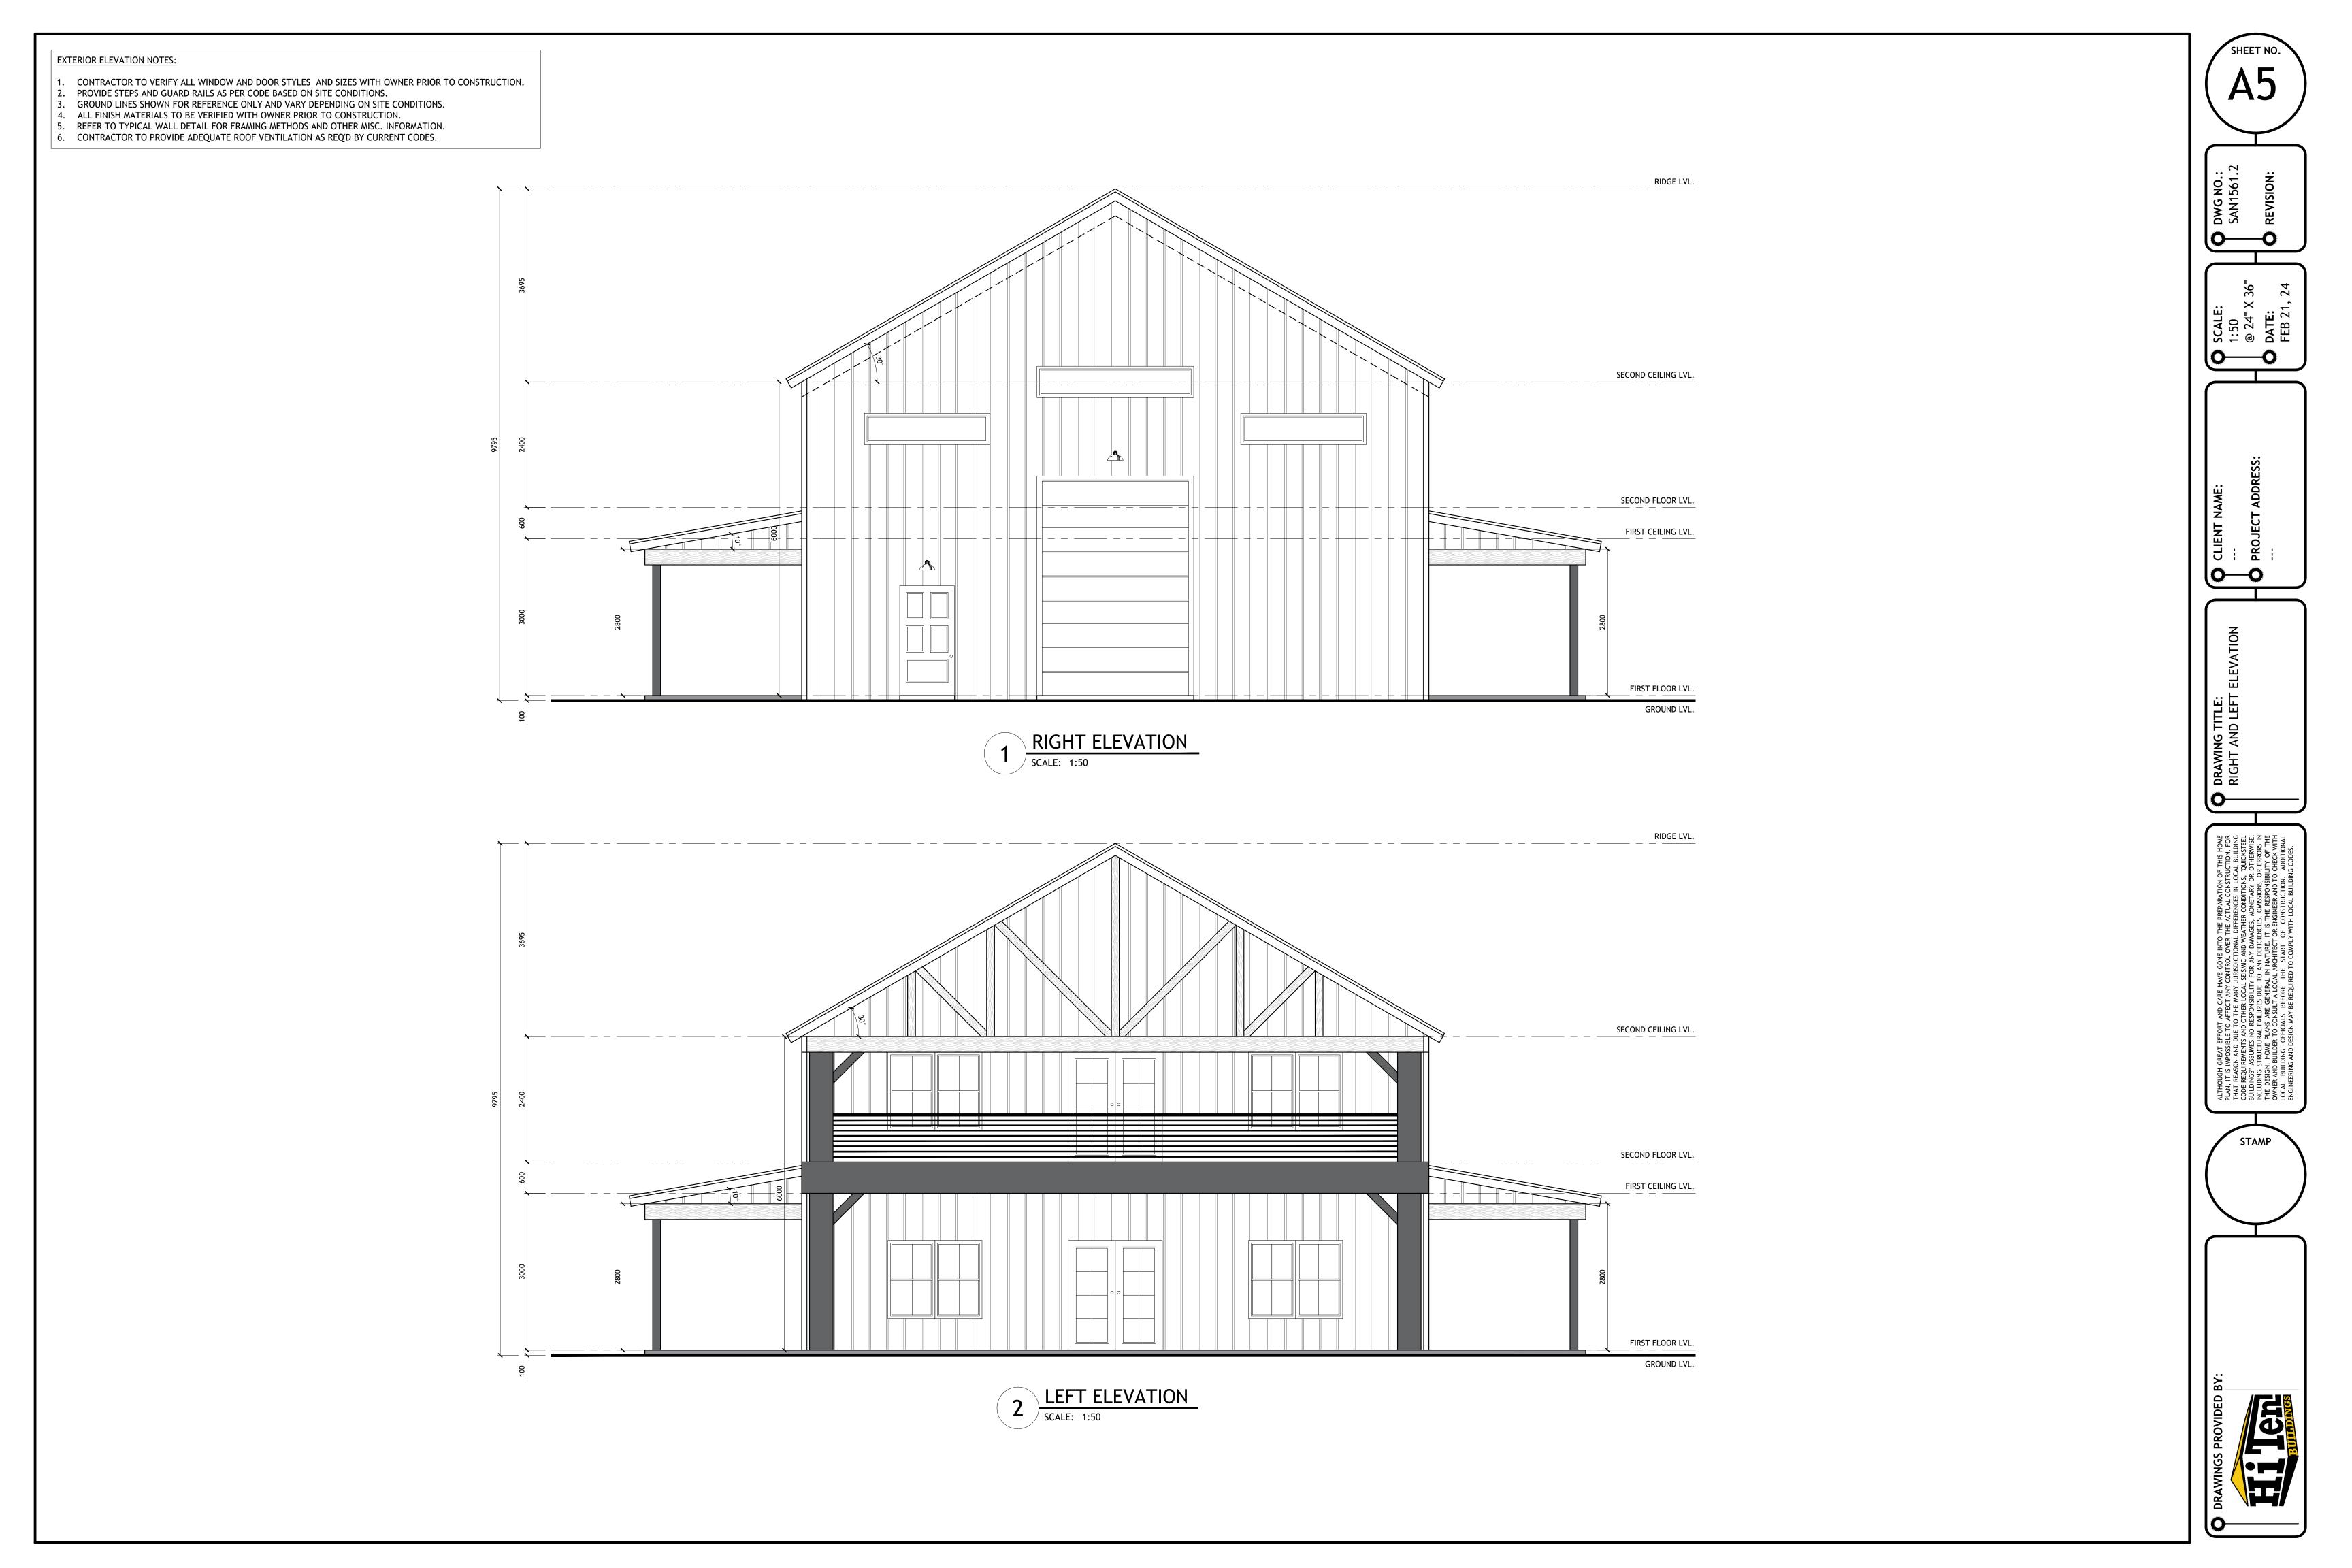

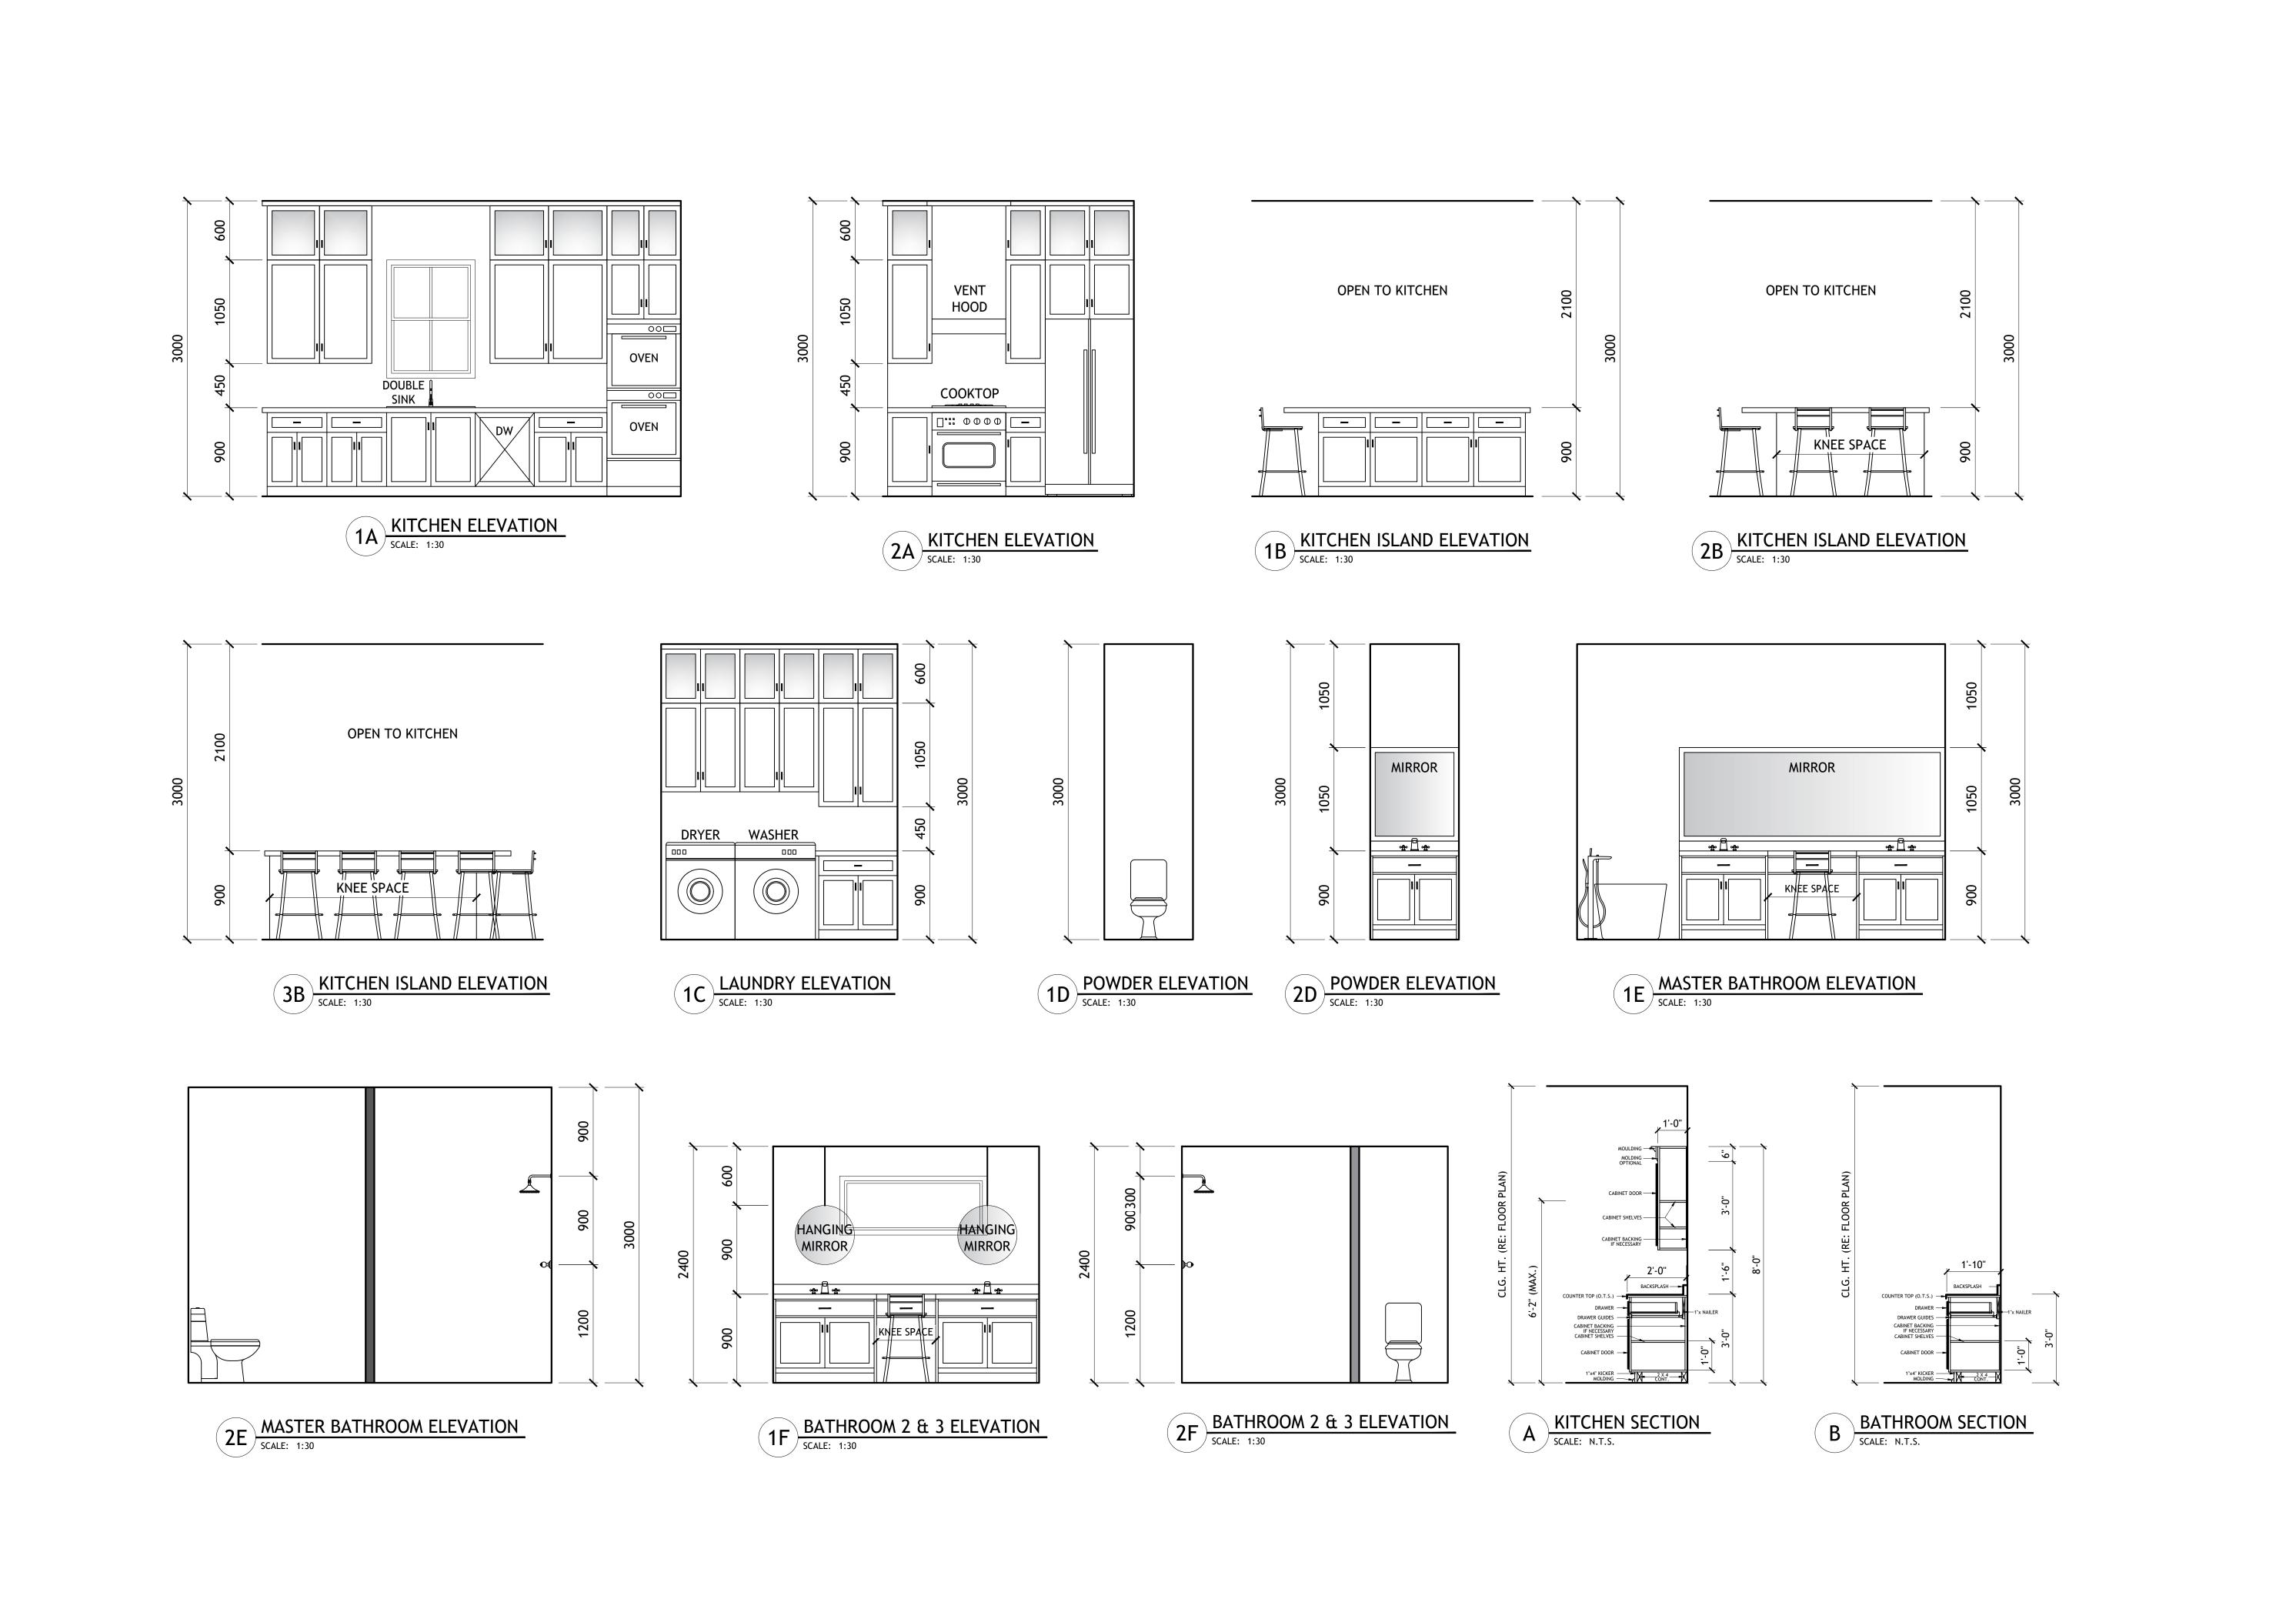

ELECTRICAL NOTES:

- IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO BID/INSTALLATION.
- 2. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY.
- 3. CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C. (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE.
- 4. CONTRACTOR SHALL COORDINATE WITH OTHER TRADES TO ENSURE INSTALLATION IS MADE IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 5. EXACT LOCATIONS AND MOUNTING HEIGHTS OF ALL LIGHTING FIXTURES, WALL OUTLETS, ETC. SHALL BE IN ACCORDANCE WITH THE LOCAL CODE AND THE CONTRACTOR ON SITE SHALL MAKE
- MODIFICATIONS AS NEEDED.


 6. ALL LIGHTING CHOICES TO BE OWNER'S CHOICE, BUT TO NOT SURPASS DESIGN STANDARDS.
- 7. ALL WORK SHALL COMPLY WITH ALL CODES APPLICABLE AT SITE.
- 8. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: EACH SLEEPING ROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS, ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN A DWELLING THE ALARM DEVICES SHALL BE INTERCONNECTED IS SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE UNIT. SMOKE ALARMS SHALL BE HARD WIRED
- WITH A BATTERY BACK UP.

 9. CARBON MONOXIDE ALARMS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED
- APPLIANCES ARE INSTALLED AND IN DWELLING UNITS WITH ATTACHED GARAGES.

 10. A 125 VOLT, SINGLE PHASE, 15-20 AMPERE RATED RECEPTACLE OUTLET SHALL BE INSTALLED AT AN ACCESSIBLE LOCATION FOR THE SERVICING OF HEATING, AIR CONDITIONING AND
- REFRIGERATION EQUIPMENT. THE RECEPTACLE SHALL BE LOCATED ON THE SAME LEVEL AND WITHIN 25 FEET OF THE EQUIPMENT. THE RECEPTACLE OUTLET SHALL NOT BE CONNECTED TO THE LOAD SIDE OF THE HVAC EQUIPMENT DISCONNECTING MEANS.


ELECTRICAL LEGEND	<u> </u>
120 VOLT RECEPTACLE	€=
120 VOLT W/ GROUND FAULT INTERRUPTOR	
240 VOLT RECEPTACLE	€
WATERPROOF RECEPTACLE	€
PHONE/CABLE (CAT5)	■
TELEVISION ANTENNA	=
SINGLE POLE SWITCH	\$
2 WAY SWITCH	\$2
CEILING MOUNTED HANGING LIGHT	Ø
RECESSED CAN LIGHT	0
FLUSH MOUNTED LIGHT	0
WALL MOUNTED LIGHT	Ω
EXHAUST FAN	•
EXHAUST FAN/ RECESS CAN COMBO	•
SMOKE DETECTOR	⊠sd
CARBON MONOXIDE DETECTOR	Æcd
STAIRCASE LIGHT	_
GARAGE LIGHT	
UNDER CABINET LIGHT	
CCTV CAMERA	[CAM]
CEILING FAN WITH LIGHT	


NOT ALL SYMBOLS ARE USED.

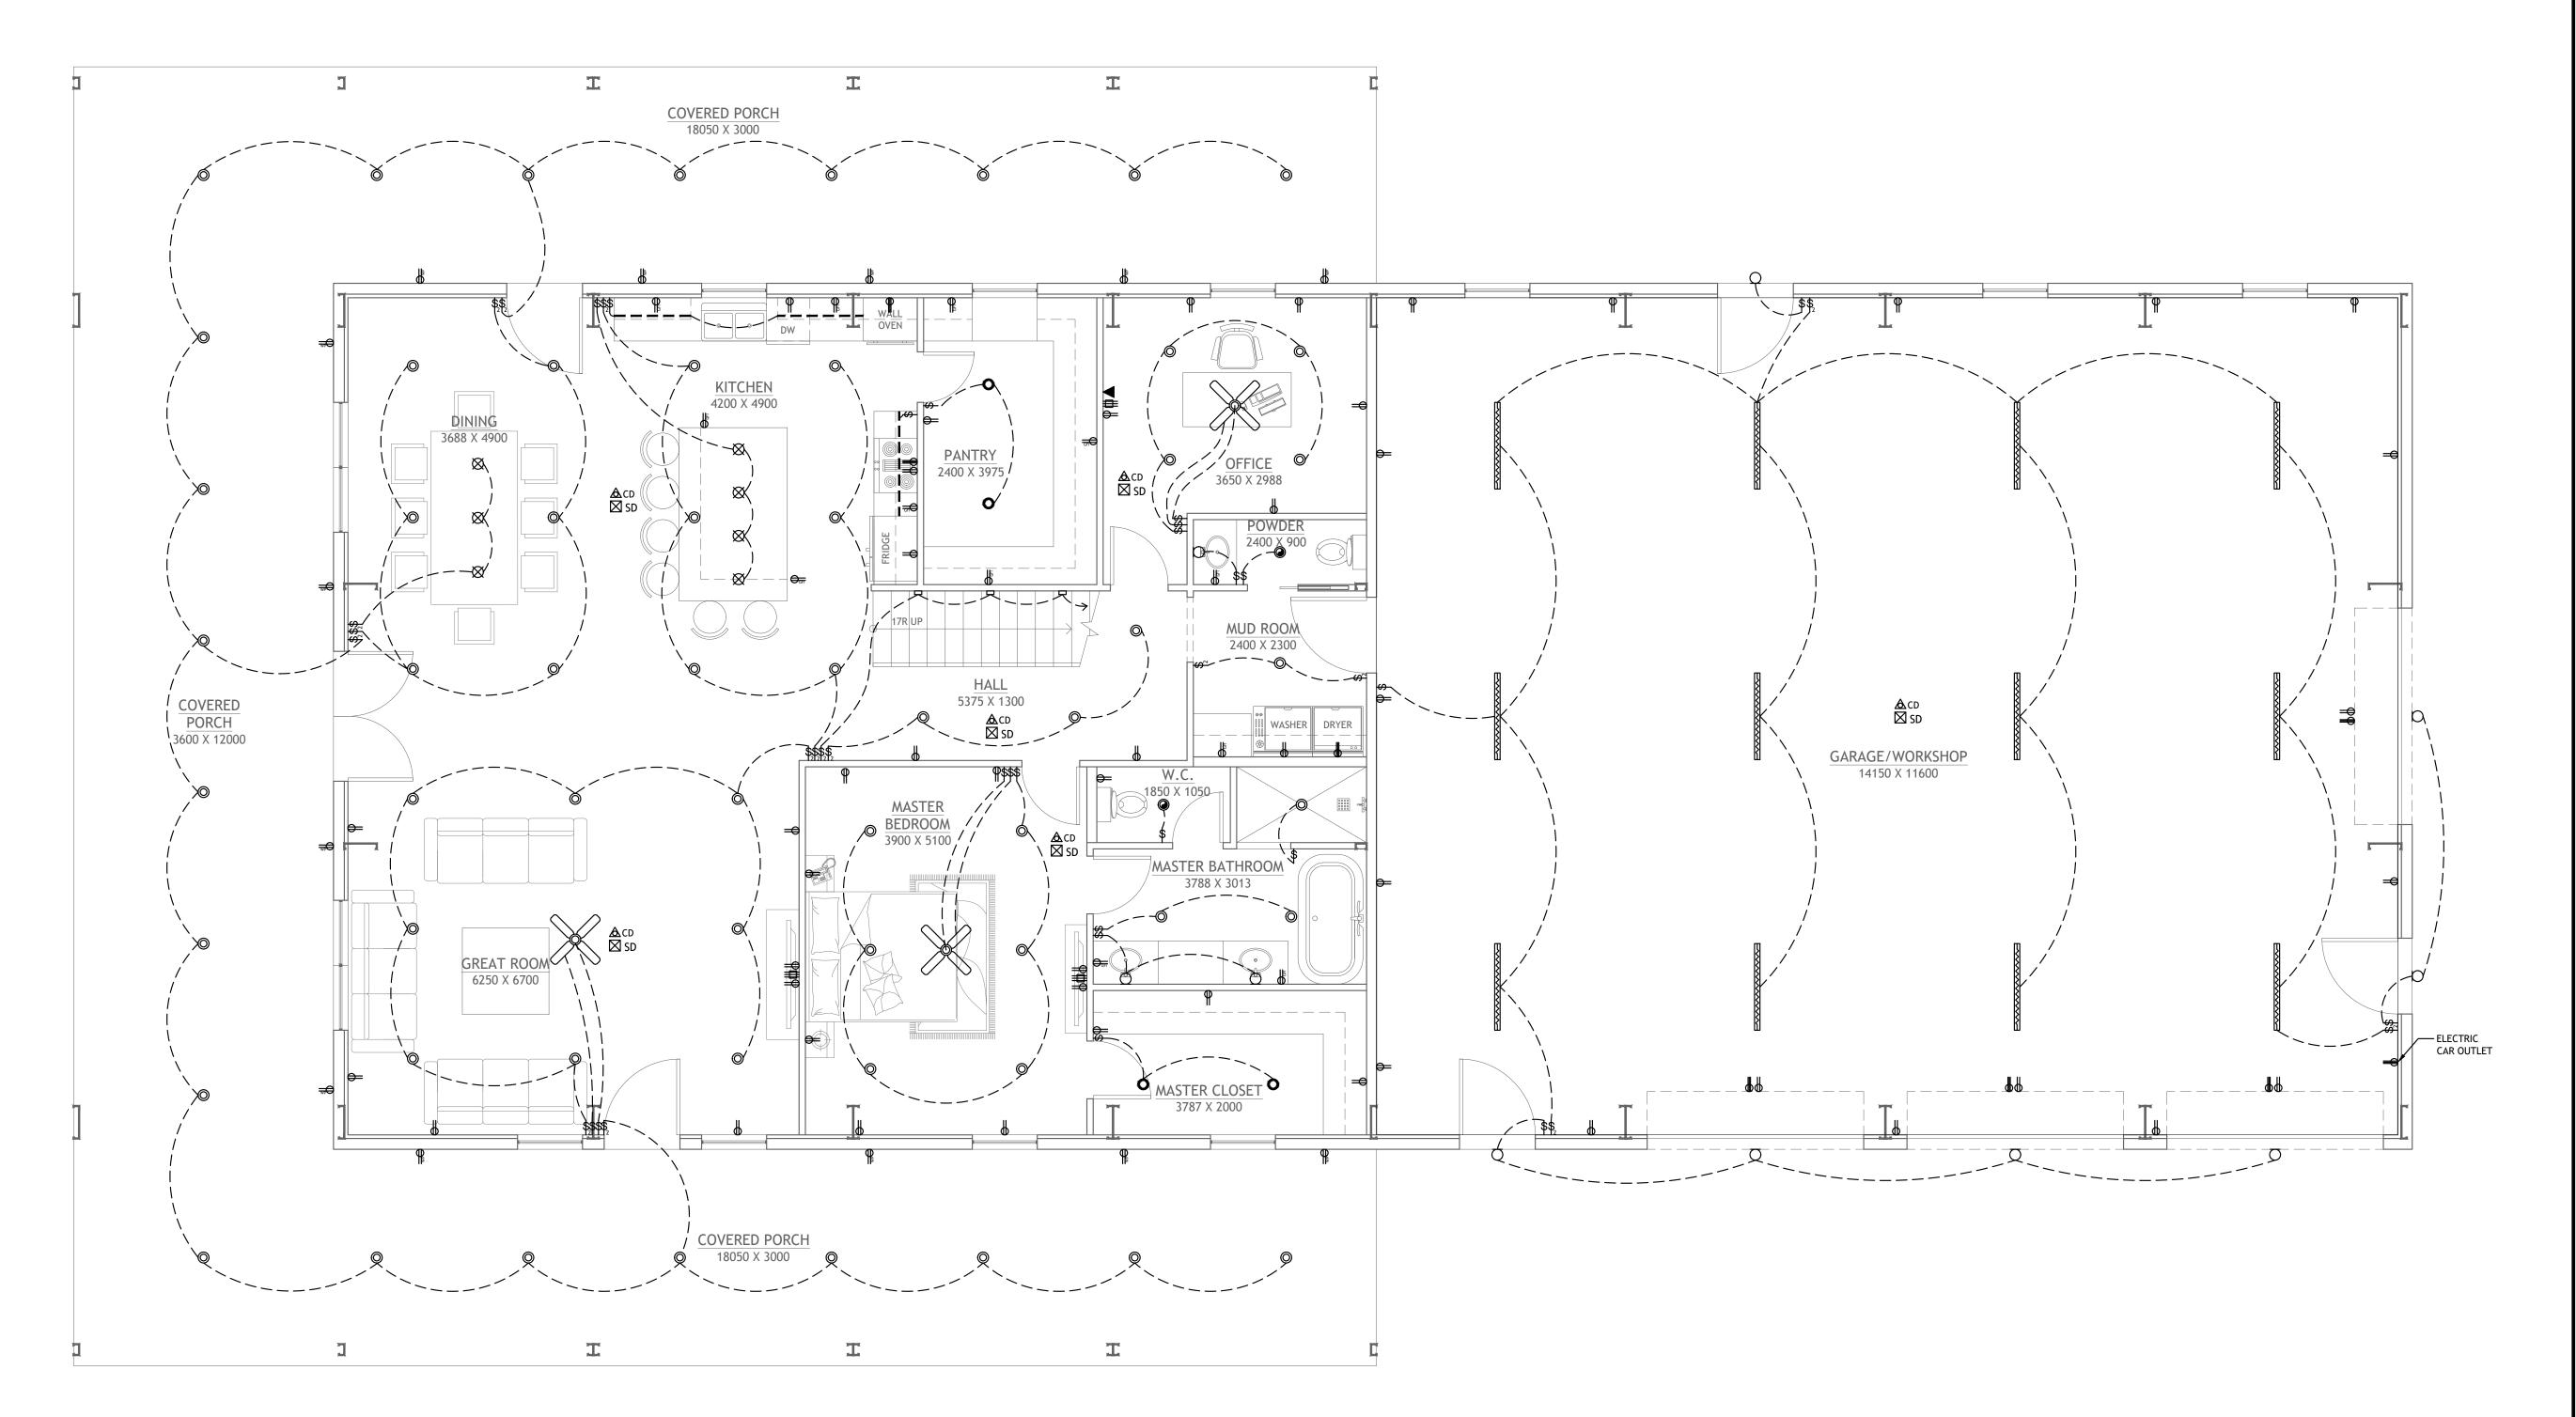















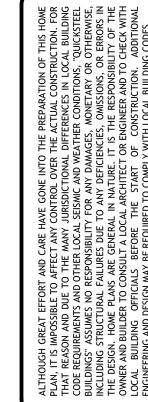





ELECTRICAL NOTES:


- 1. IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO BID/INSTALLATION.
- 2. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL
- DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY.

 3. CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C.
- (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE.


 4. CONTRACTOR SHALL COORDINATE WITH OTHER TRADES TO ENSURE INSTALLATION IS MADE IN ACCORDANCE WITH THE
- CONTRACT DOCUMENTS.
 5. EXACT LOCATIONS AND MOUNTING HEIGHTS OF ALL LIGHTING FIXTURES, WALL OUTLETS, ETC. SHALL BE IN ACCORDANCE WITH
- THE LOCAL CODE AND THE CONTRACTOR ON SITE SHALL MAKE MODIFICATIONS AS NEEDED.


 6. ALL LIGHTING CHOICES TO BE OWNER'S CHOICE, BUT TO NOT SURPASS DESIGN STANDARDS.
- 7. ALL WORK SHALL COMPLY WITH ALL CODES APPLICABLE AT SITE.
- 8. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: EACH SLEEPING ROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS, ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN A DWELLING THE ALARM DEVICES SHALL BE INTERCONNECTED IS SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE UNIT. SMOKE ALARMS SHALL BE HARD WIRED WITH A BATTERY BACK UP.
- CARBON MONOXIDE ALARMS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS WITH ATTACHED GARAGES.
- 10. A 125 VOLT, SINGLE PHASE, 15-20 AMPERE RATED RECEPTACLE OUTLET SHALL BE INSTALLED AT AN ACCESSIBLE LOCATION FOR THE SERVICING OF HEATING, AIR CONDITIONING AND REFRIGERATION EQUIPMENT. THE RECEPTACLE SHALL BE LOCATED ON THE SAME LEVEL AND WITHIN 25 FEET OF THE EQUIPMENT. THE RECEPTACLE OUTLET SHALL NOT BE CONNECTED TO THE LOAD SIDE OF THE HVAC EQUIPMENT DISCONNECTING MEANS.

ELECTRICAL LEGEND	
120 VOLT RECEPTACLE	₩
120 VOLT W/ GROUND FAULT INTERRUPTOR	© ज़
240 VOLT RECEPTACLE	-
WATERPROOF RECEPTACLE	Owp
PHONE/CABLE (CAT5)	■
TELEVISION ANTENNA	#
SINGLE POLE SWITCH	\$
2 WAY SWITCH	\$ ₂
CEILING MOUNTED HANGING LIGHT	Ø
RECESSED CAN LIGHT	0
FLUSH MOUNTED LIGHT	0
WALL MOUNTED LIGHT	Ω
EXHAUST FAN	•
EXHAUST FAN/ RECESS CAN COMBO	•
SMOKE DETECTOR	⊠sd
CARBON MONOXIDE DETECTOR	Æcd
STAIRCASE LIGHT	
GARAGE LIGHT	
UNDER CABINET LIGHT	
CCTV CAMERA	[CAM]
CEILING FAN WITH LIGHT	X
NOTE:	
NOT ALL SYMBOLS ARE USED.	

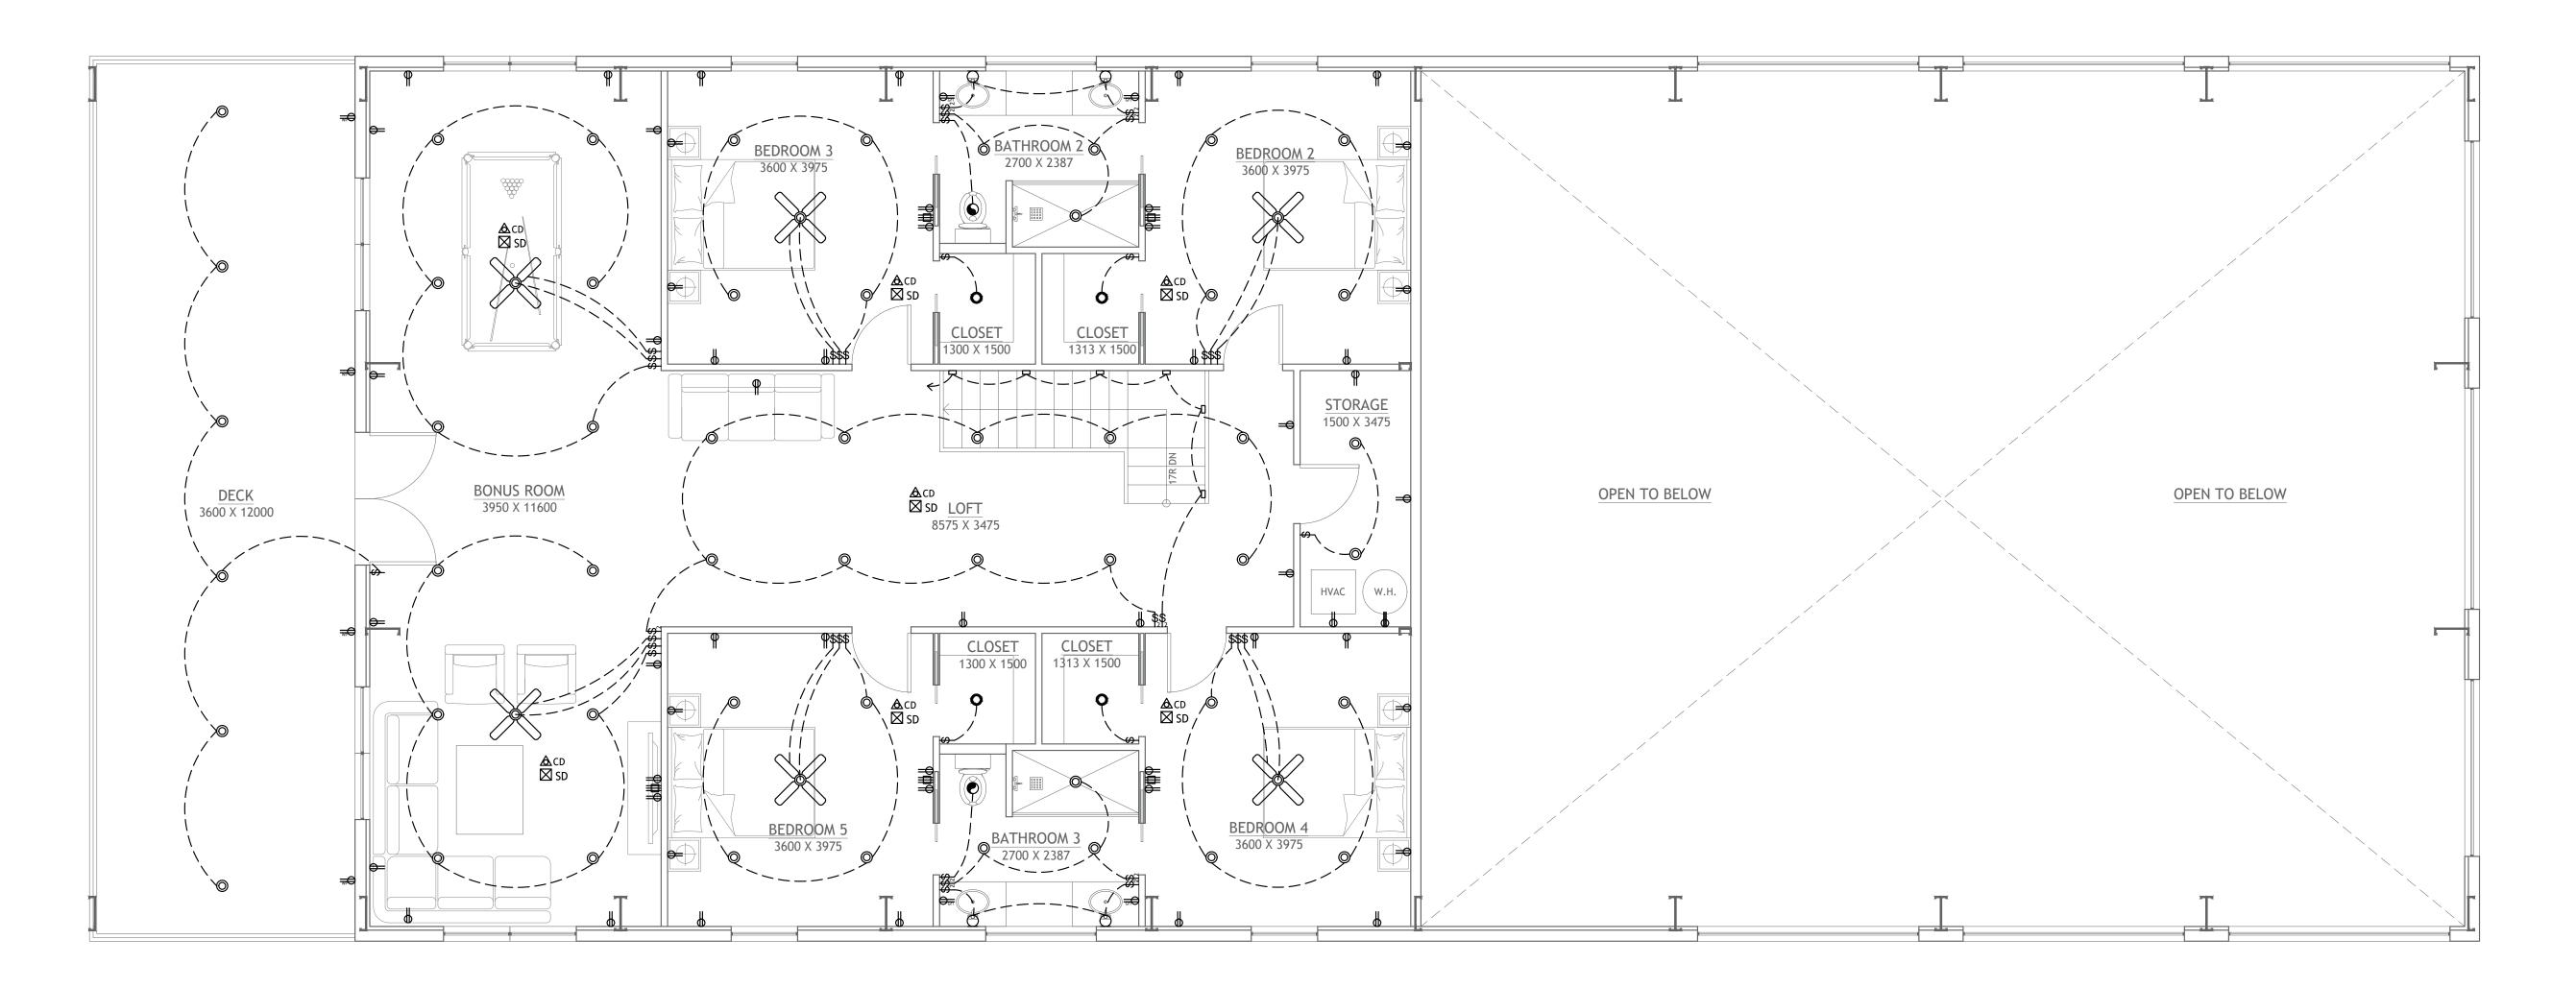

1 SECOND FLOOR ELECTRICAL PLAN

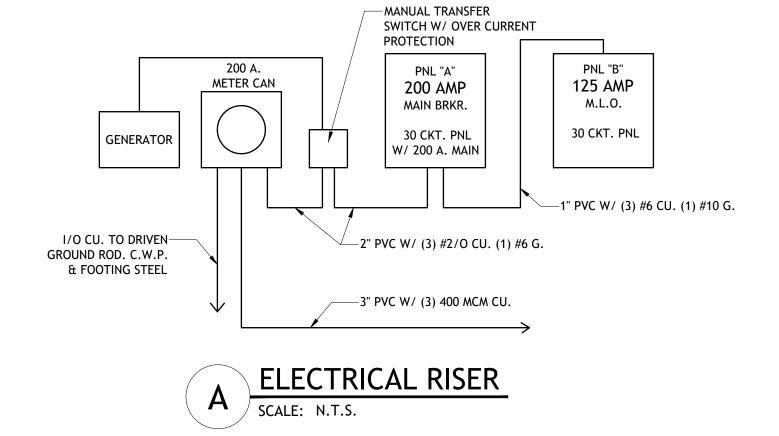

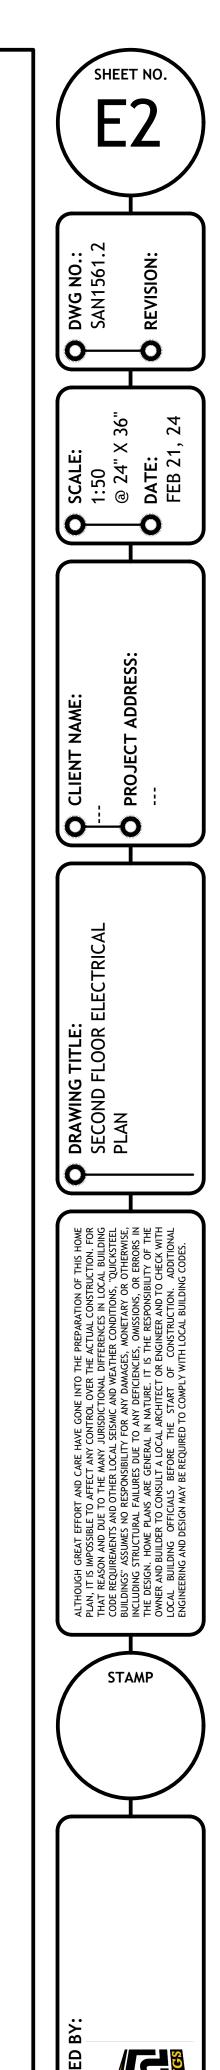

PLUMBING NOTES:

STANDARDS.

- IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO
- BID/INSTALLATION. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY.
- CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C. (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE.
- 4. SUGGESTED SLOPE FOR EXTERIOR WASTE LINE @ 5MM=300MM. 5. ALL YARD CLEANOUTS TO BE CONTRACTOR CHOICE. ALL FIXTURES WILL BE OWNER CHOICE. CALCULATIONS AND CHOICES BASED ON INDUSTRY
- WASHING MACHINE AND DISHWASHER TO BE CUSTOMER'S CHOICE.
- 7. WATER HEATER TO BE CUSTOMER'S CHOICE.


PLUMBING LEGEND	
COLD WATER	CW
HOT WATER	———HW ———
SEWER LINE	SW
GAS LINE	———GAS———
VENT PIPE	•
HOSE BIBB	HB <u>T</u>
CLEAN OUT	Θ

FIXTURE CONNECTIONS

	PIPE DIAMETER				
FIXTURE	SEWER	VENT	COLD WATER	HOT WATER	
HAND SINK	50	50	15	15	
WATER CLOSET	100	50	20	N/A	
FLOOR DRAIN	75	50	N/A	N/A	
WATER HEATER	N/A	N/A	20	20	
WASHER/DRYER	50	N/A	20	20	
HOSE	N/A	N/A	15	15	
SINK	50	50	15	15	

NOTE:

- SIZES SHOWN ARE MINIMUM UNIFORM PLUMBING CODE REQUIREMENTS FOR TRAPS, TRAP ARM & ROUGH-IN CONNECTION.
- IF CAST IRON NO-HUB PIPE IS USED, WASTE AND
- VENT PIPE SHALL BE 50MM MINIMUM. ALL FIXTURES TO HAVE VENTILATION PIPE TO CEILING EVEN IF NOT SHOWED ON PLANS.

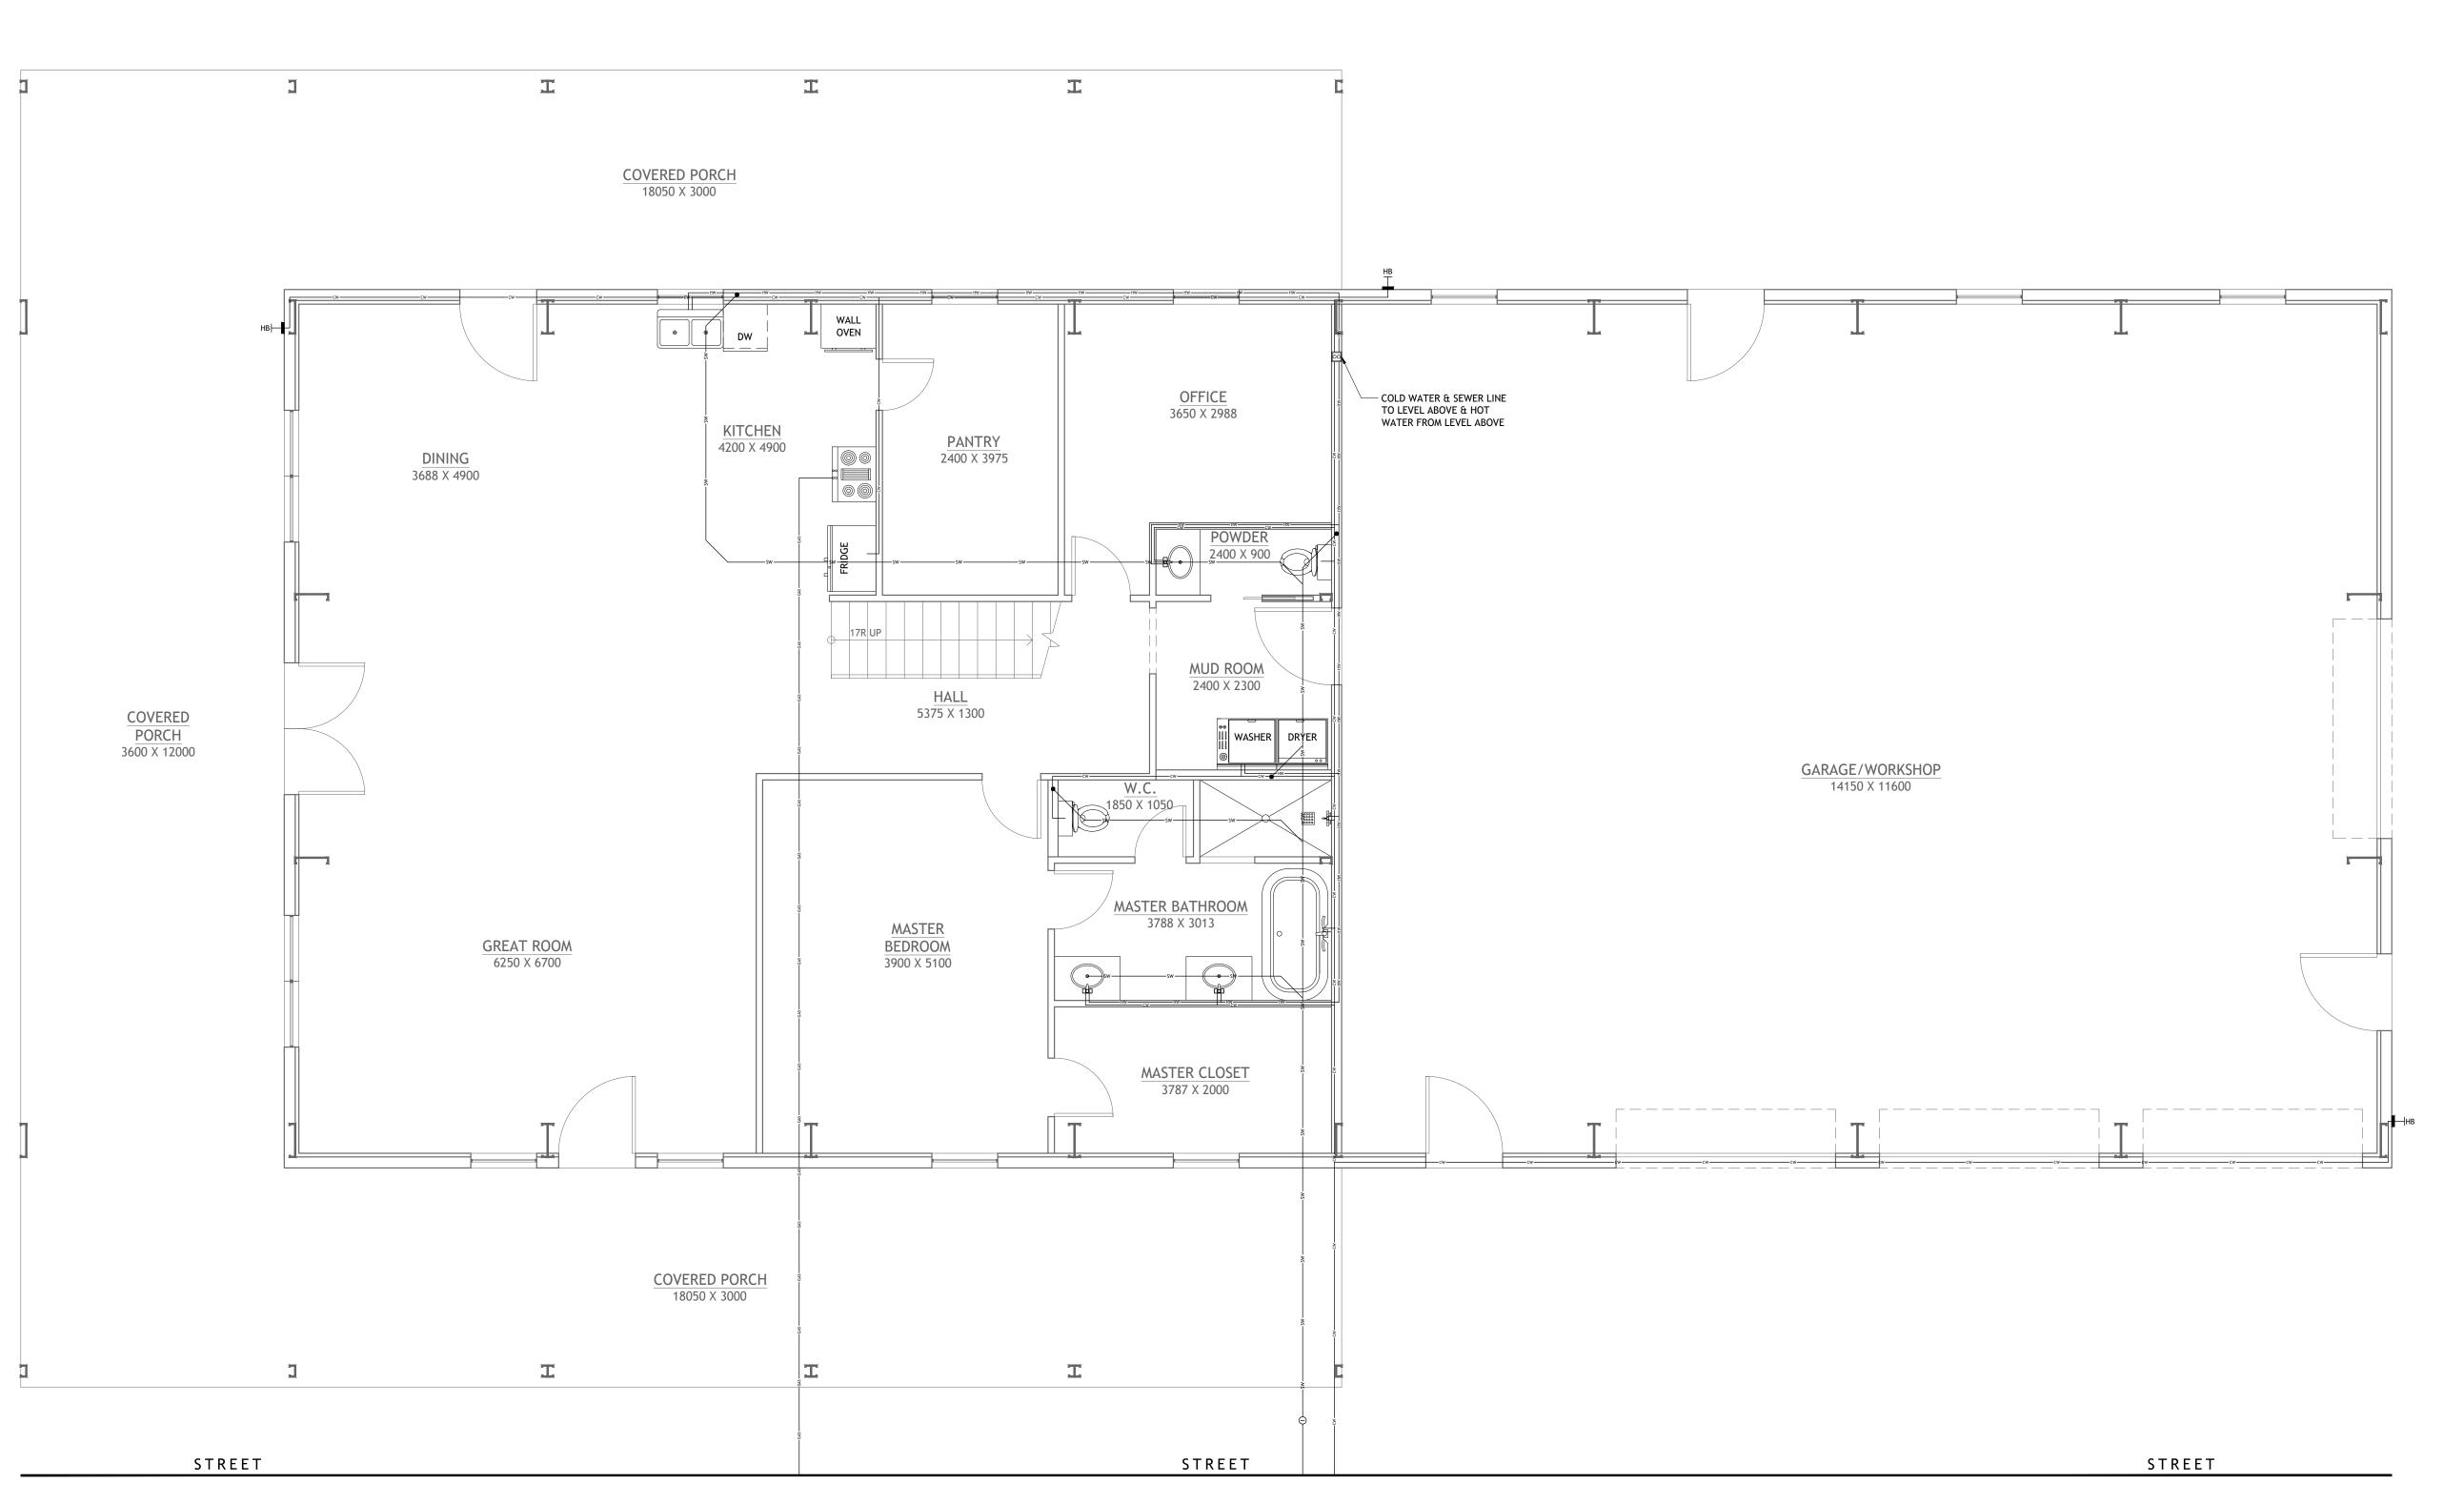



PLUMBING NOTES:


- IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO
- BID/INSTALLATION. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY.
- CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C. (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE.
- SUGGESTED SLOPE FOR EXTERIOR WASTE LINE @ 5MM=300MM. 5. ALL YARD CLEANOUTS TO BE CONTRACTOR CHOICE. ALL FIXTURES WILL BE OWNER CHOICE. CALCULATIONS AND CHOICES BASED ON INDUSTRY STANDARDS.
- WASHING MACHINE AND DISHWASHER TO BE CUSTOMER'S CHOICE. 7. WATER HEATER TO BE CUSTOMER'S CHOICE.


PLUMBING LEGEND	
COLD WATER	CW
HOT WATER	———НW ———
SEWER LINE	SW
GAS LINE	———GAS———
VENT PIPE	•
HOSE BIBB	нв Т
CLEAN OUT	Θ
FIVELINE COMMENTA	NC


| FIXTURE CONNECTIONS


		PIPE DIAMETER				
	FIXTURE	SEWER	VENT	COLD WATER	HOT WATER	
	HAND SINK	50	50	15	15	
	WATER CLOSET	100	50	20	N/A	
	FLOOR DRAIN	75	50	N/A	N/A	
	WATER HEATER	N/A	N/A	20	20	
	WASHER/DRYER	50	N/A	20	20	
	HOSE	N/A	N/A	15	15	
	SINK	50	50	15	15	

- SIZES SHOWN ARE MINIMUM UNIFORM PLUMBING CODE REQUIREMENTS FOR TRAPS, TRAP ARM &
- ROUGH-IN CONNECTION. IF CAST IRON NO-HUB PIPE IS USED, WASTE AND
- VENT PIPE SHALL BE 50MM MINIMUM. ALL FIXTURES TO HAVE VENTILATION PIPE TO CEILING EVEN IF NOT SHOWED ON PLANS.

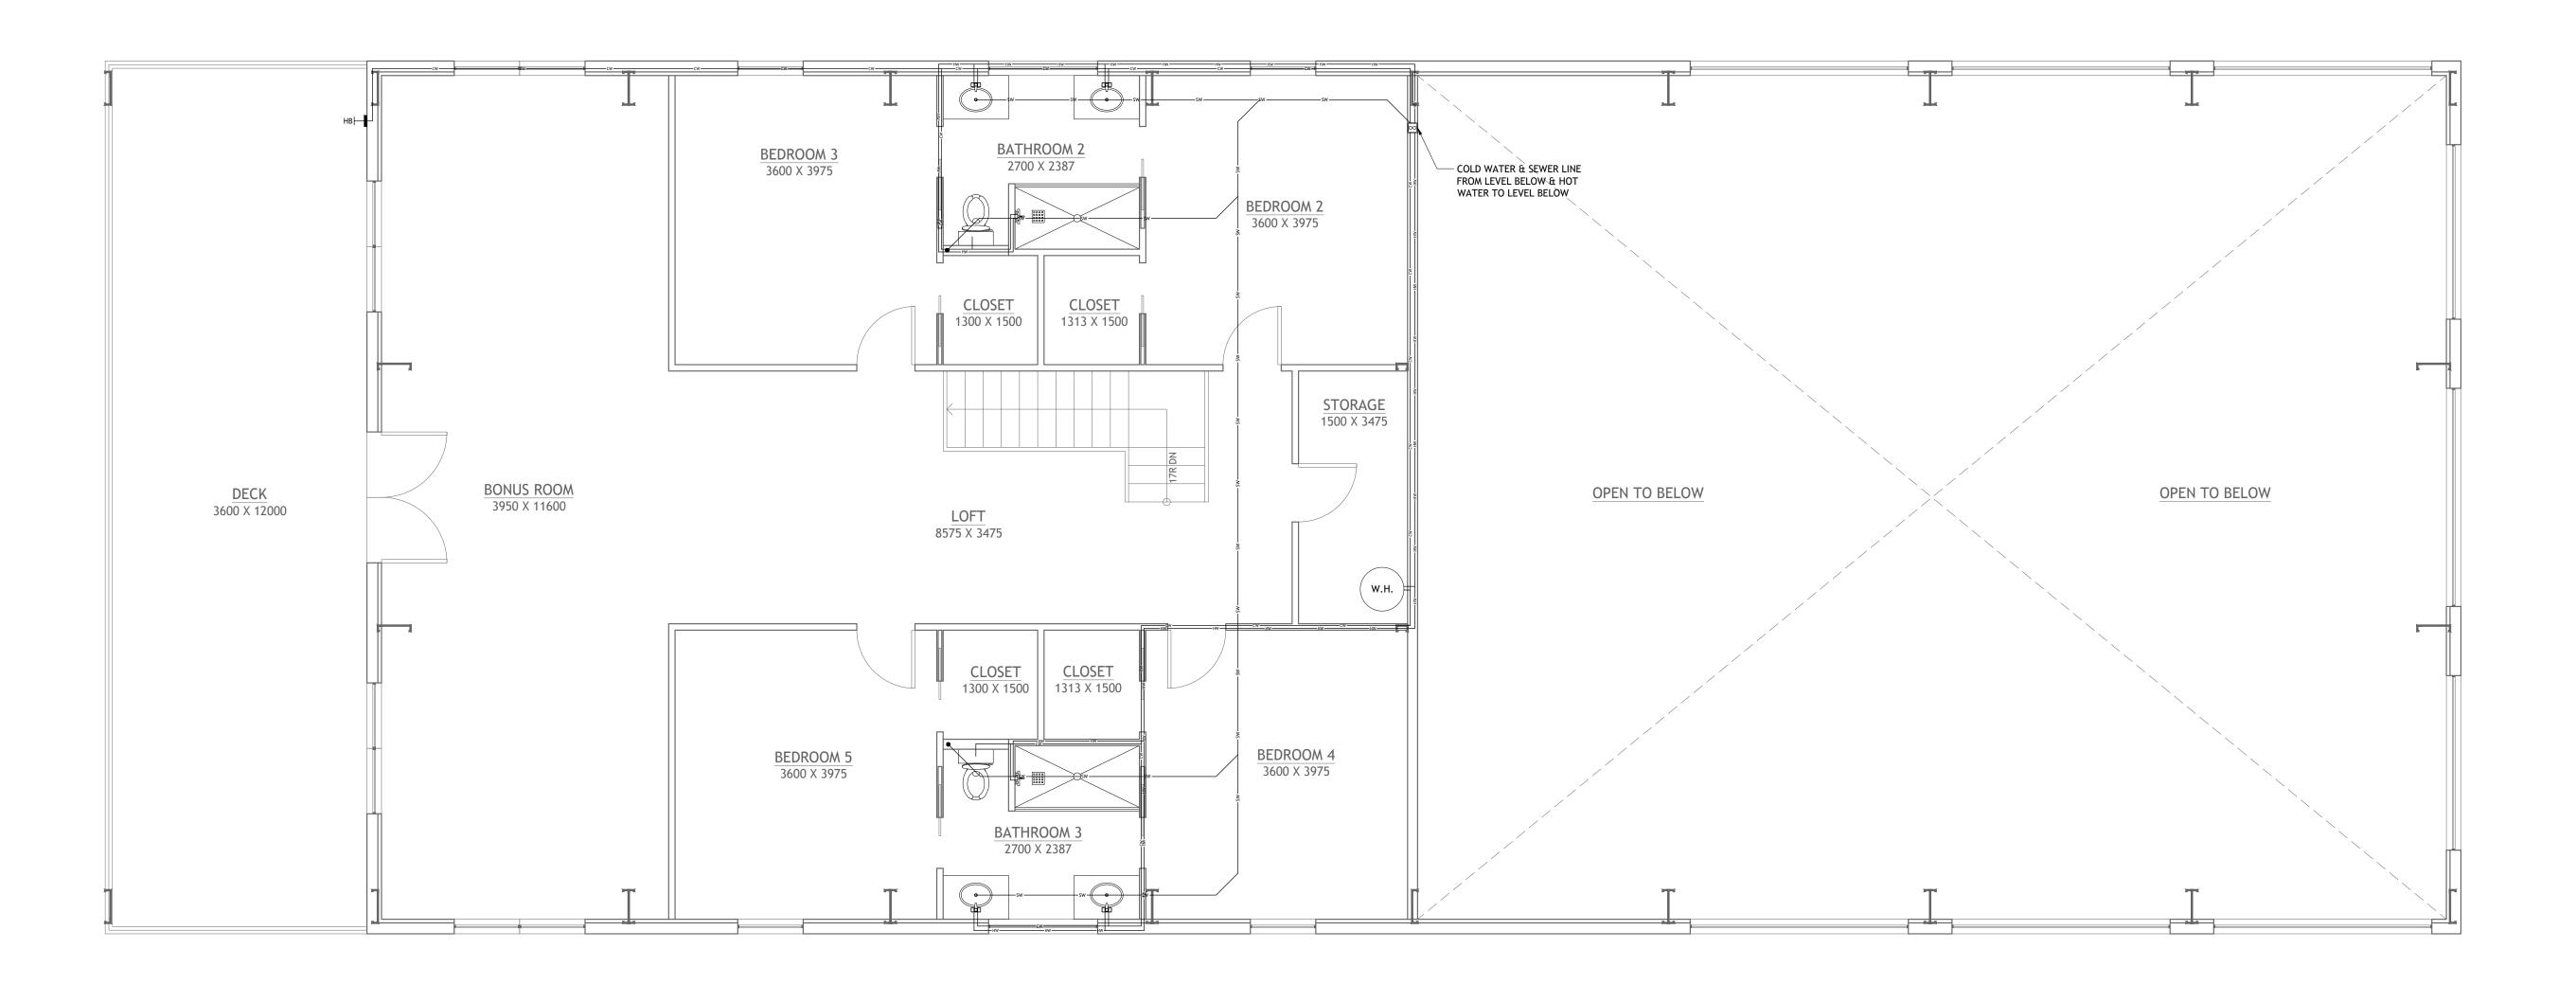


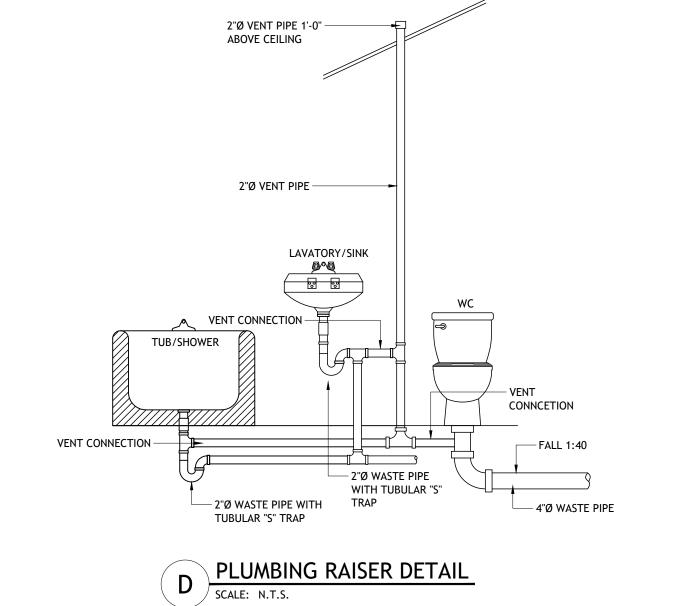


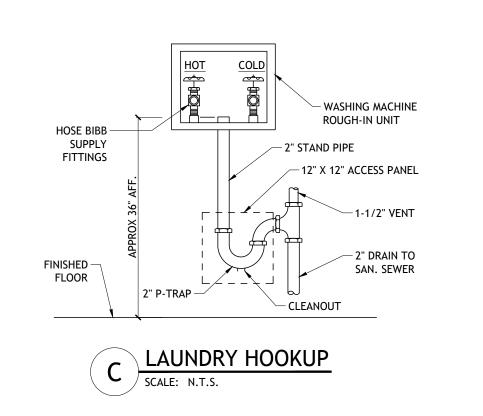

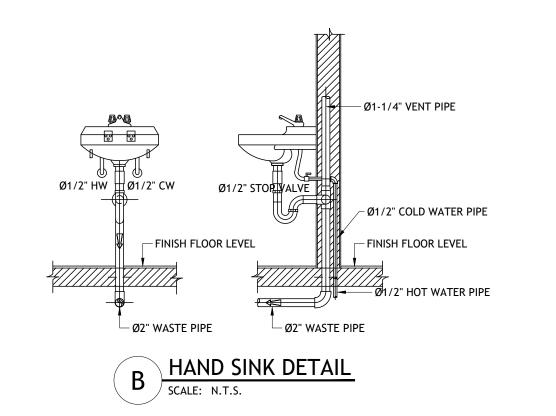


SECOND FLOOR PLUMBING PLAN
SCALE: 1:50

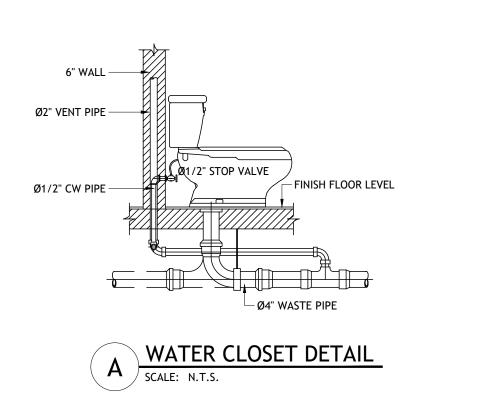

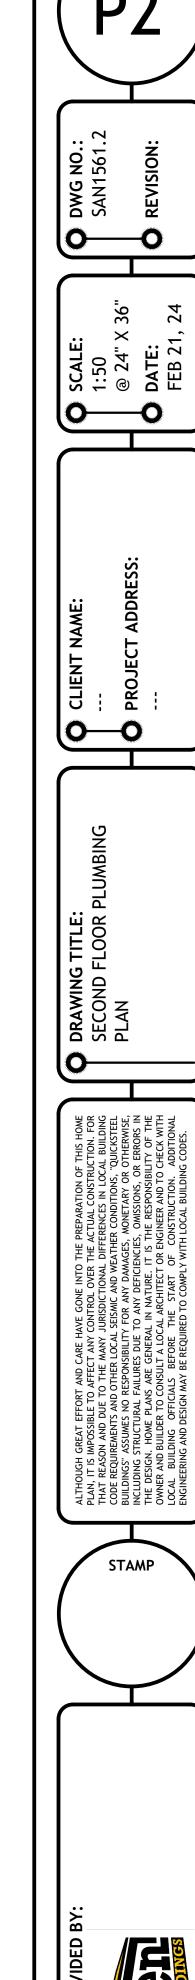


SHEET NO

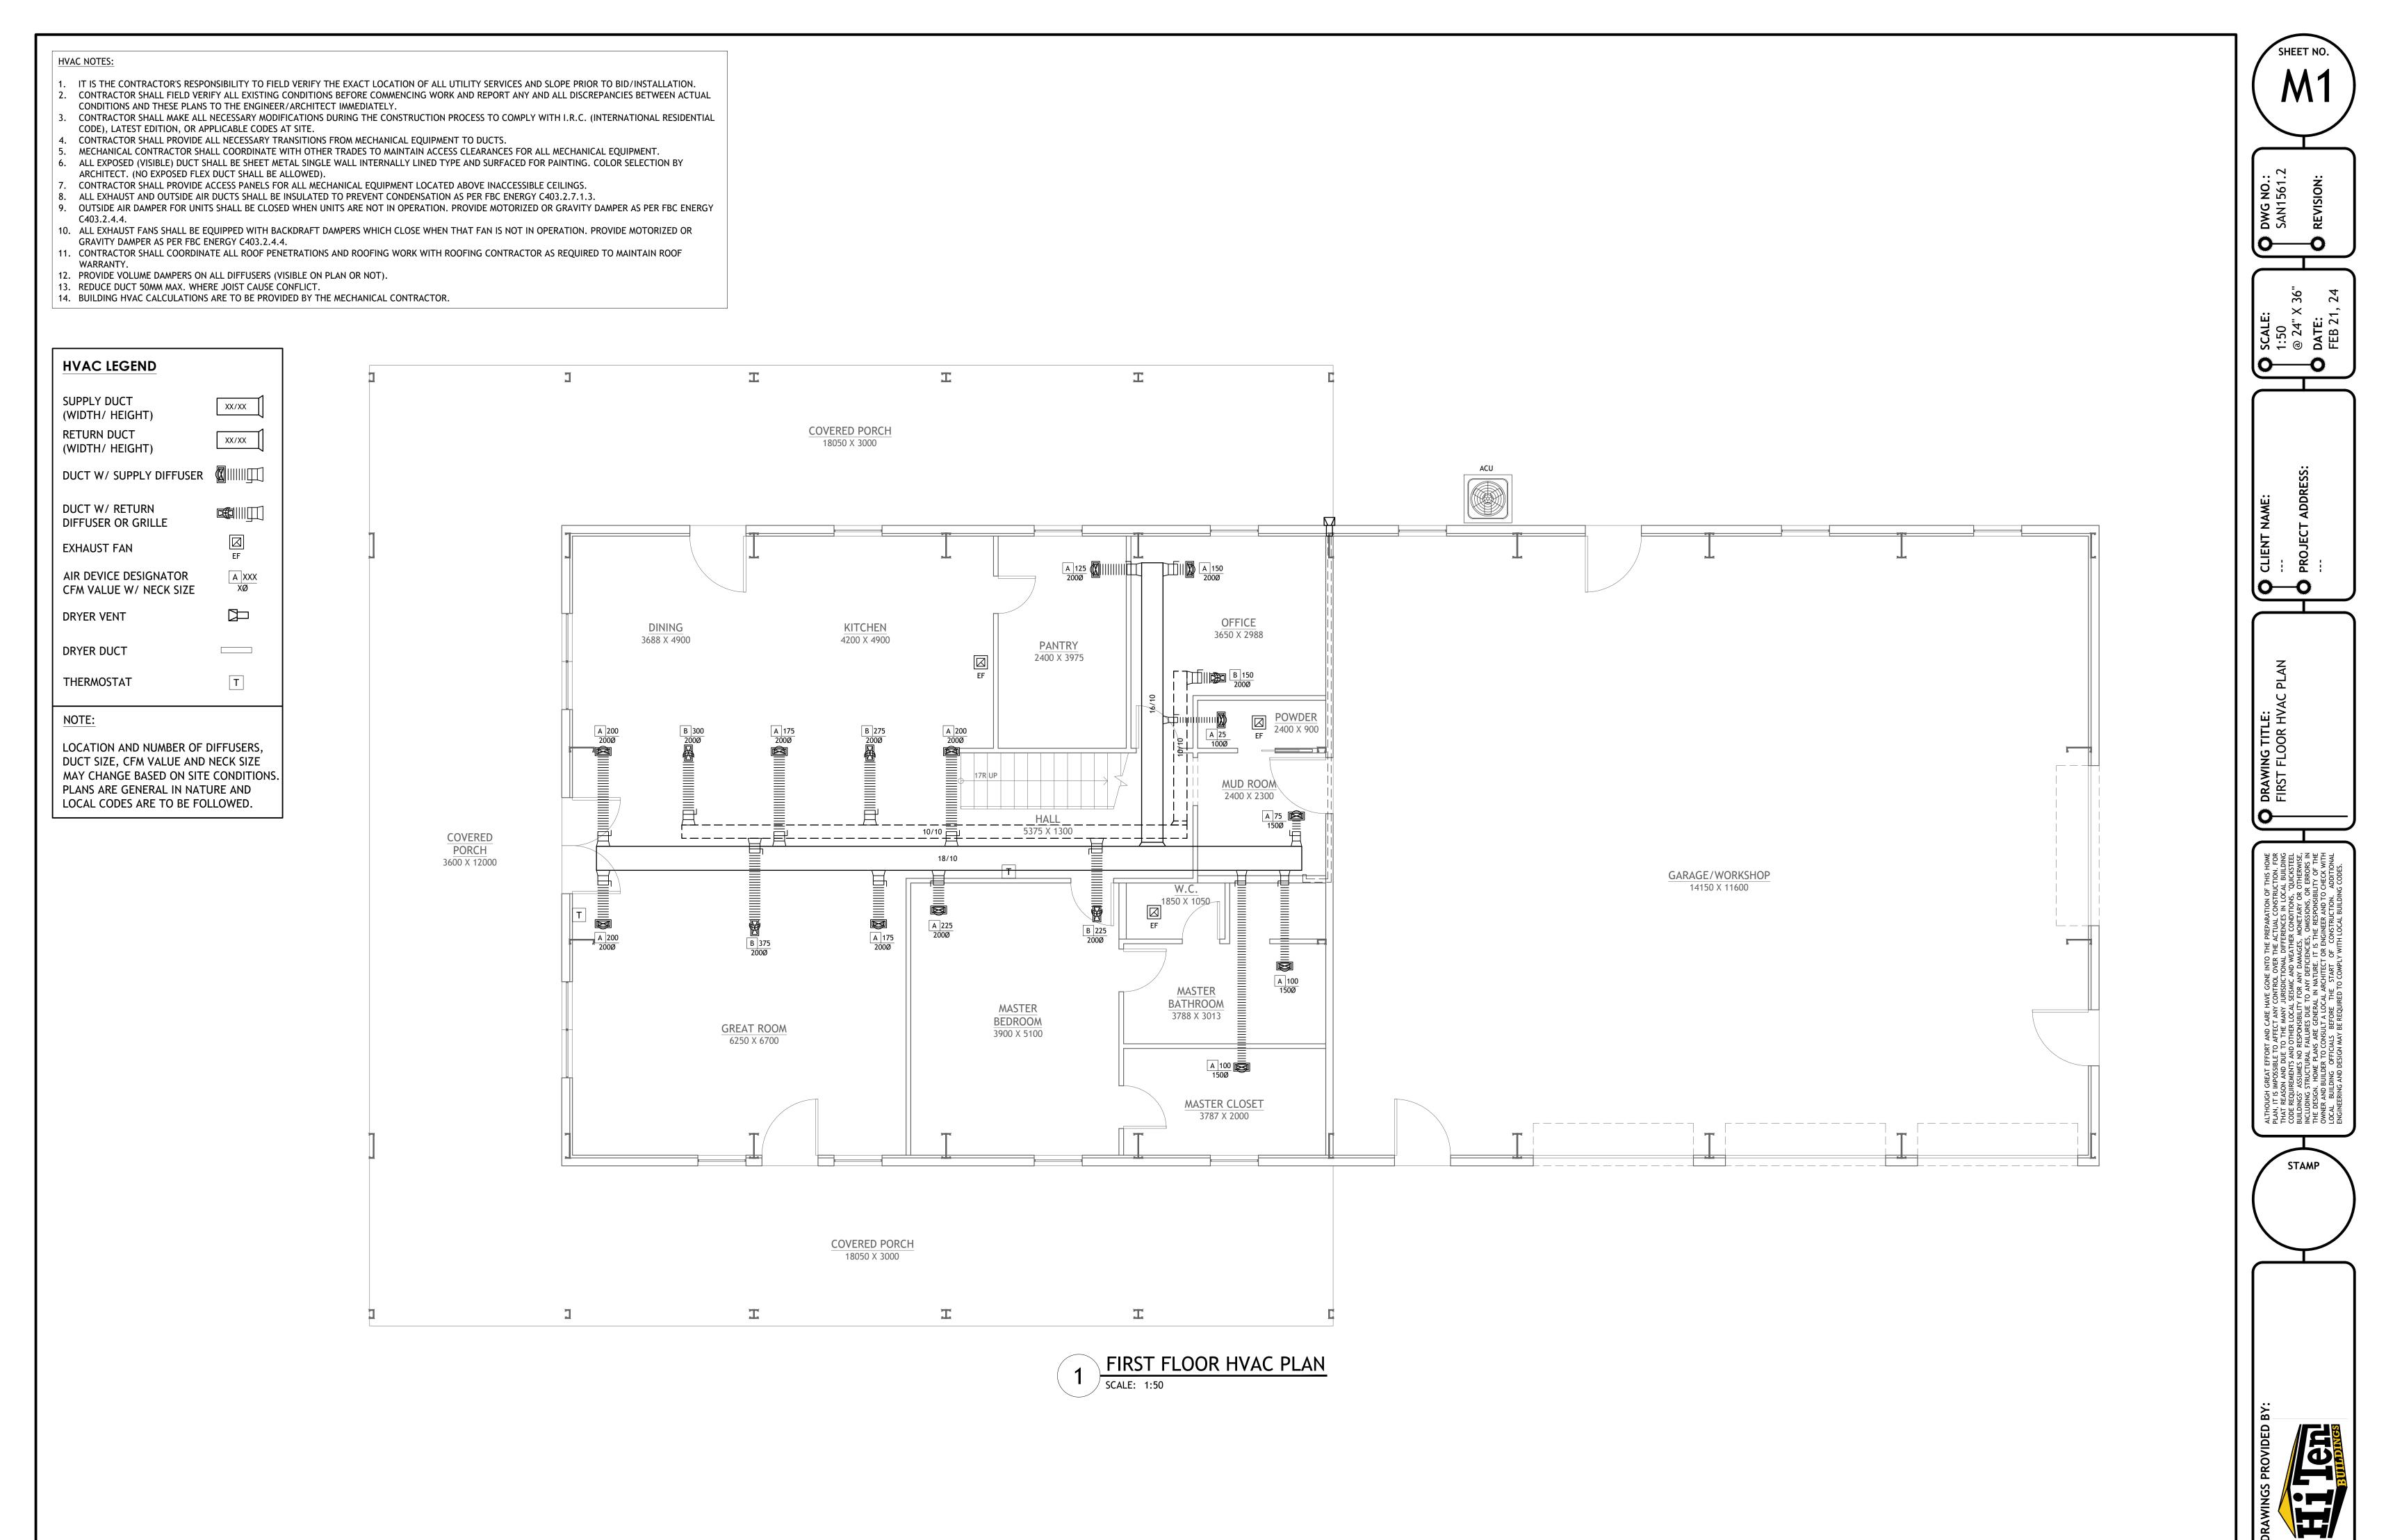

HVAC NOTES:

C403.2.7.1.3.


- IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO BID/INSTALLATION.
- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL DISCREPANCIES BETWEEN ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT
- CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY
- WITH I.R.C. (INTERNATIONAL RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE.
- CONTRACTOR SHALL PROVIDE ALL NECESSARY TRANSITIONS FROM MECHANICAL EQUIPMENT TO DUCTS. 5. MECHANICAL CONTRACTOR SHALL COORDINATE WITH OTHER TRADES TO MAINTAIN ACCESS CLEARANCES FOR ALL MECHANICAL EQUIPMENT.
- 6. ALL EXPOSED (VISIBLE) DUCT SHALL BE SHEET METAL SINGLE WALL INTERNALLY LINED TYPE AND SURFACED FOR PAINTING. COLOR SELECTION BY ARCHITECT. (NO EXPOSED FLEX DUCT SHALL BE ALLOWED).
- CONTRACTOR SHALL PROVIDE ACCESS PANELS FOR ALL MECHANICAL EQUIPMENT LOCATED ABOVE INACCESSIBLE
- CEILINGS. 8. ALL EXHAUST AND OUTSIDE AIR DUCTS SHALL BE INSULATED TO PREVENT CONDENSATION AS PER FBC ENERGY
- 9. OUTSIDE AIR DAMPER FOR UNITS SHALL BE CLOSED WHEN UNITS ARE NOT IN OPERATION. PROVIDE MOTORIZED OR GRAVITY DAMPER AS PER FBC ENERGY C403.2.4.4.
- 10. ALL EXHAUST FANS SHALL BE EQUIPPED WITH BACKDRAFT DAMPERS WHICH CLOSE WHEN THAT FAN IS NOT IN OPERATION. PROVIDE MOTORIZED OR GRAVITY DAMPER AS PER FBC ENERGY C403.2.4.4.
- 11. CONTRACTOR SHALL COORDINATE ALL ROOF PENETRATIONS AND ROOFING WORK WITH ROOFING CONTRACTOR
- AS REQUIRED TO MAINTAIN ROOF WARRANTY. 12. PROVIDE VOLUME DAMPERS ON ALL DIFFUSERS (VISIBLE ON PLAN OR NOT).
- 13. REDUCE DUCT 50MM MAX. WHERE JOIST CAUSE CONFLICT. 14. BUILDING HVAC CALCULATIONS ARE TO BE PROVIDED BY THE MECHANICAL CONTRACTOR.

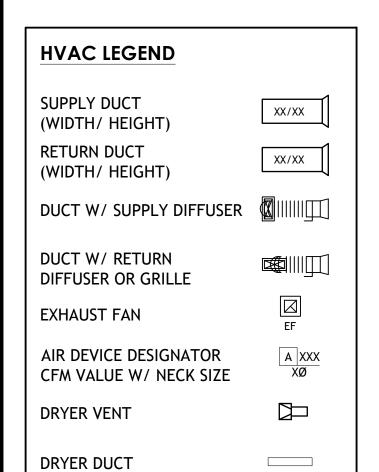


THERMOSTAT

LOCATION AND NUMBER OF DIFFUSERS, DUCT SIZE, CFM VALUE AND NECK SIZE MAY CHANGE BASED ON SITE CONDITIONS. PLANS ARE GENERAL IN NATURE AND LOCAL CODES ARE TO BE FOLLOWED.


T

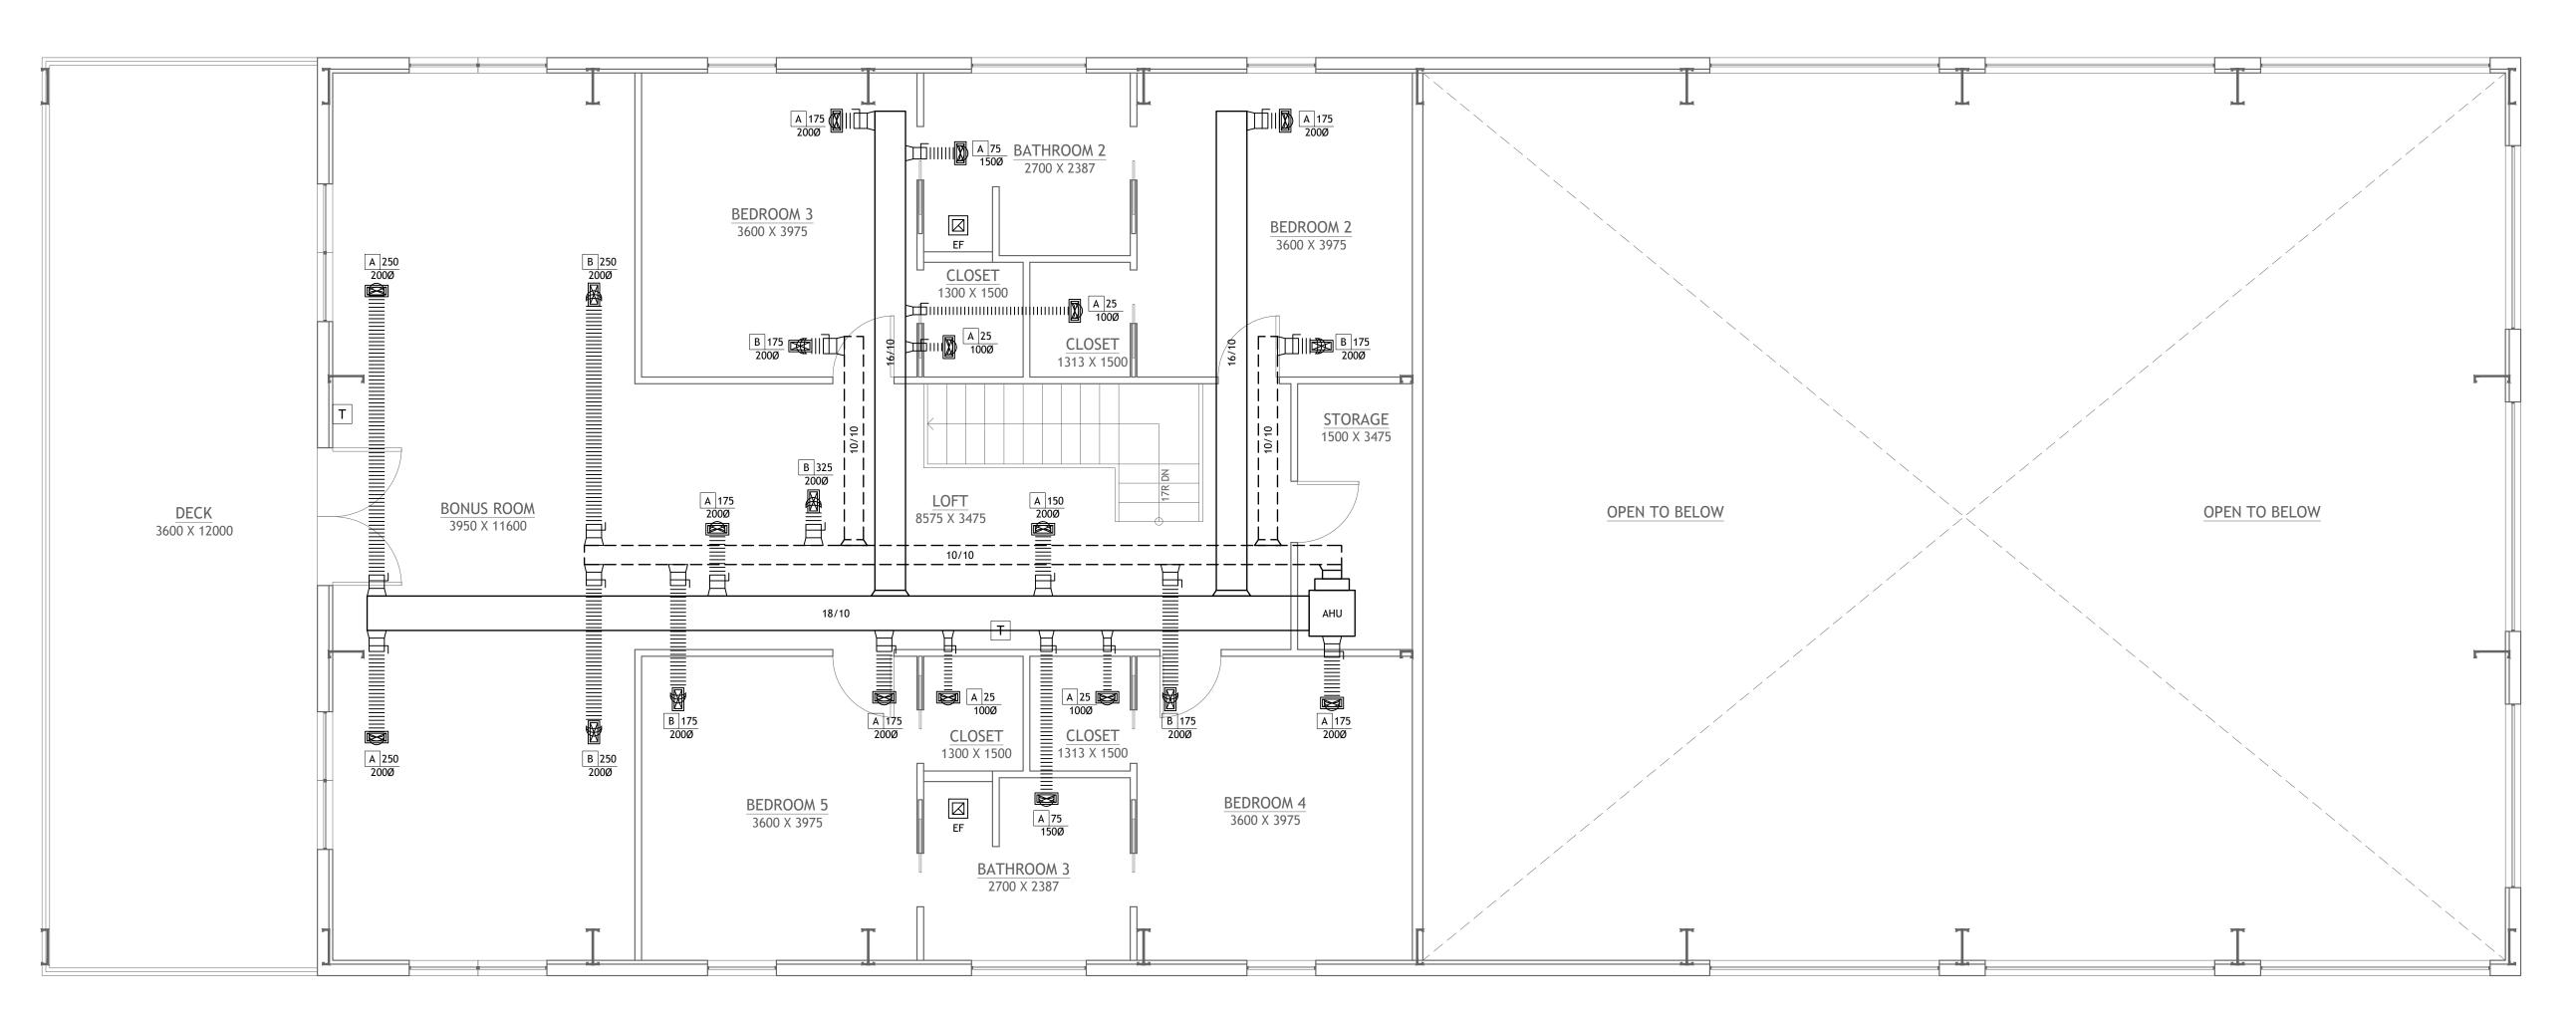




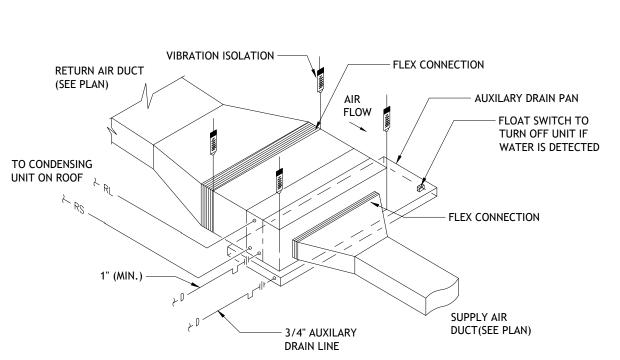


A HORIZONTAL AIR HANDLING UNIT WITH DUCTED DISCHARGE AND RETURN SCALE: N.T.S.

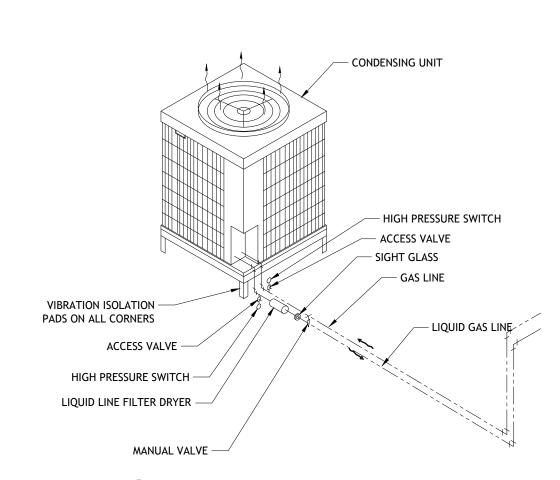


CONDENSING UNIT INSTALLATION
SCALE: N.T.S.

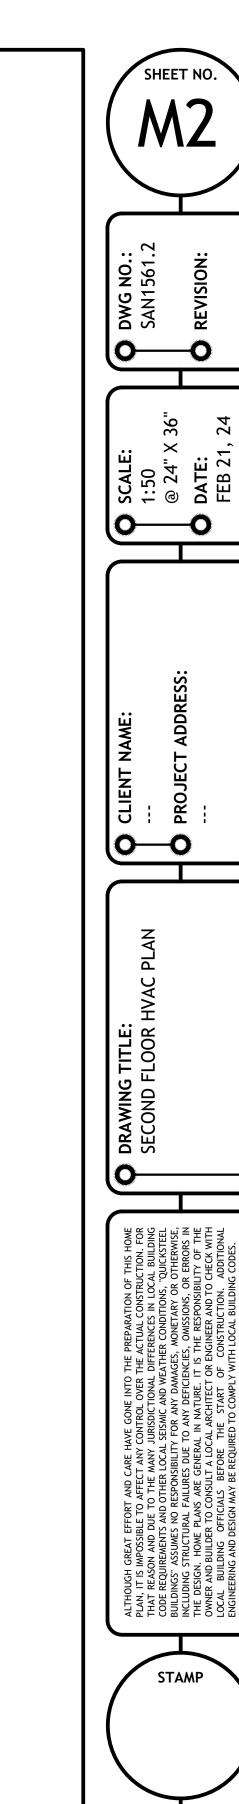







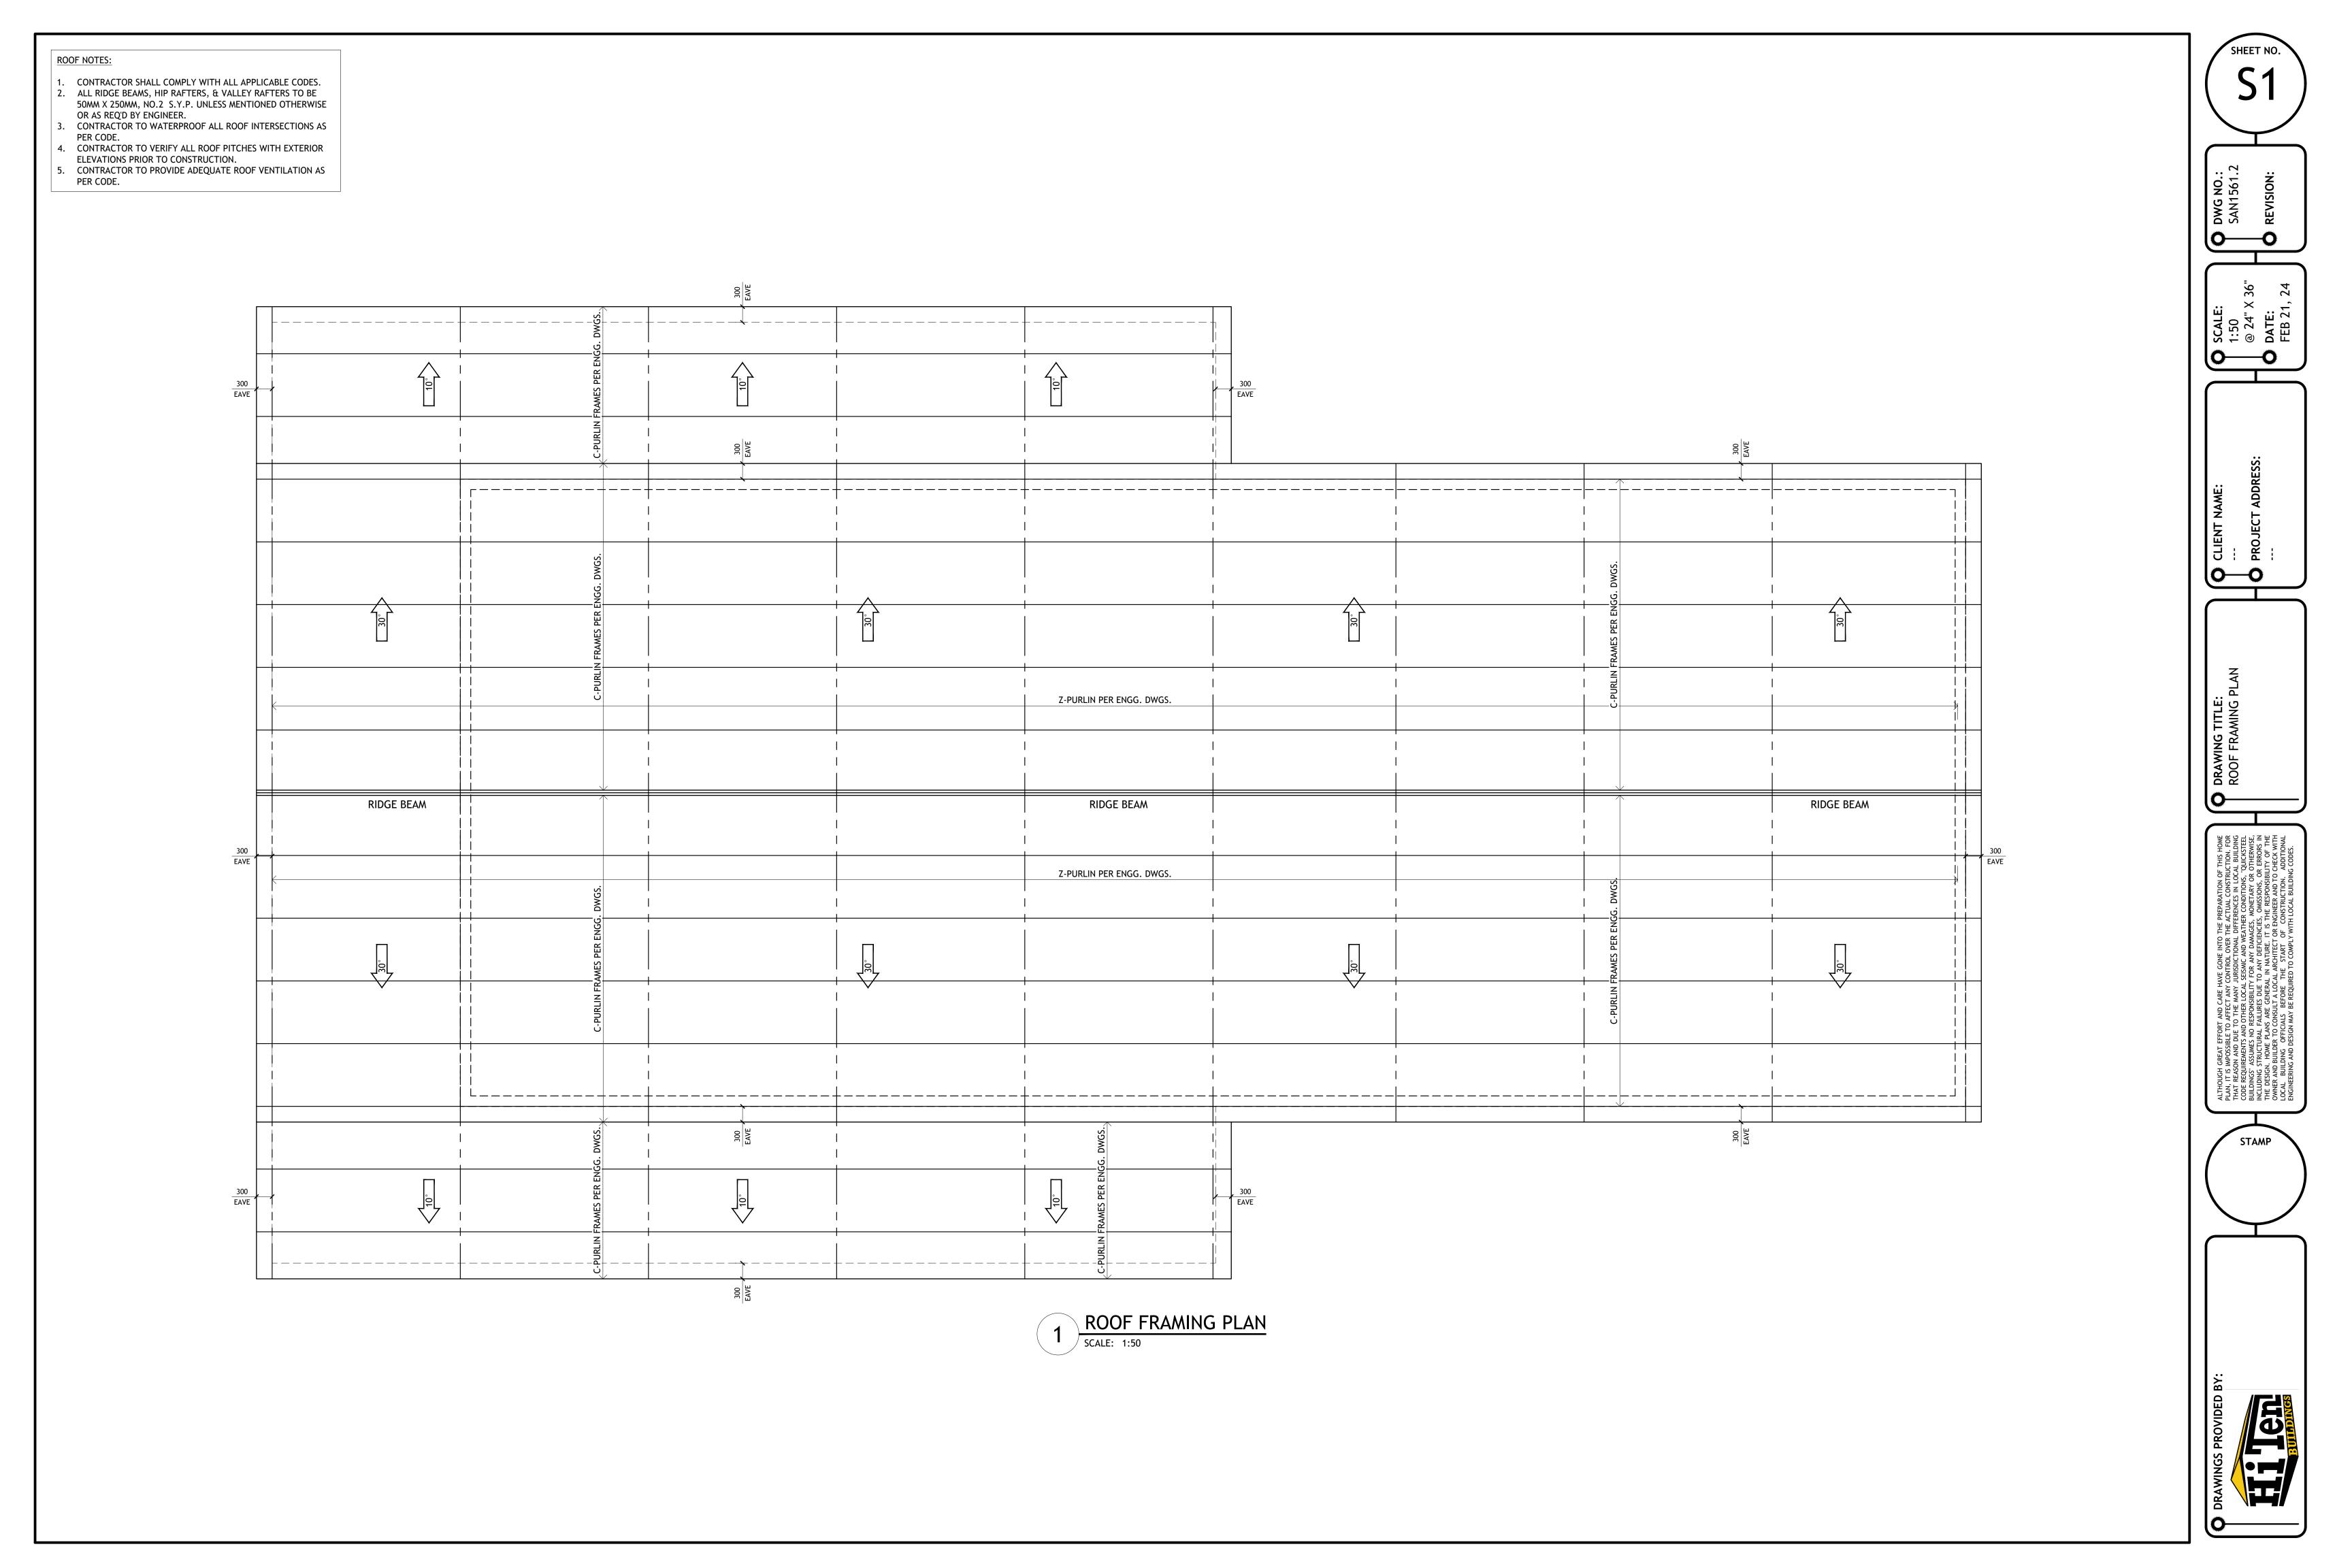


SPECIFICATION NOTES FOUNDATION NOTES: SITE DRAINAGE: IT IS RECOMMENDED THAT THE DRAINAGE BE WELL DEVELOPED. SURFACE WATER IT IS THE CONTRACTOR'S RESPONSIBILITY TO FIELD VERIFY THE EXACT LOCATION OF ALL UTILITY SERVICES AND SLOPE PRIOR TO BID/INSTALLATION. REINFORCED CONCRETE SHALL CONFORM TO APPLICABLE REQUIREMENTS CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING WORK AND REPORT ANY AND ALL DISCREPANCIES BETWEEN OF THE 2012 I.R.C. AND ALL LOCAL CITY OR COUNTY GUIDELINES. SHOULD BE DIRECTED AWAY FROM THE FOUNDATION SOILS. (USE A MINIMUM SLOPE ACTUAL CONDITIONS AND THESE PLANS TO THE ENGINEER/ARCHITECT IMMEDIATELY. 2. ALL CONCRETE USED IN THE FOUNDATIONS AND SLABS ON GRADE OF 2% WITHIN 10 FEET OF THE FOUNDATION. NO PONDING OF SURFACE WATER CONTRACTOR SHALL MAKE ALL NECESSARY MODIFICATIONS DURING THE CONSTRUCTION PROCESS TO COMPLY WITH I.R.C. (INTERNATIONAL SHALL HAVE A 28 DAY COMPRESSIVE STRENGTH OF NOT LESS THAN 3,000 PSI. SHALL BE ALLOWED NEAR THE STRUCTURE DURING OR AFTER COMPLETION OF THE RESIDENTIAL CODE), LATEST EDITION, OR APPLICABLE CODES AT SITE. THE MAXIMUM SLUMP SHALL NOT EXCEED 100MM. CONSTRUCTION AND THE LANDSCAPING. THE BUILDER SHALL ADVISE THE OWNER OF 4. SEE ARCHITECTURAL DRAWINGS FOR CONCRETE SLAB ELEVATIONS, DEPRESSIONS, SLOPES, OPENINGS, CURBS, DRAINS, TRENCHES, SLAB EDGE 4. PROVIDE CONTROL JOINTS IN ALL EXPOSED SLABS ON GRADE. THE SITE DRAINAGE REQUIREMENTS. LOCATIONS, ETC., AND FOR WALL OVERALL DIMENSIONS, LOCATIONS OF OPENINGS, ETC., NOT INDICATED ON STRUCTURAL DRAWINGS. THE MAXIMUM SPACING OF CONTROL JOINTS SHALL BE 500MM O.G., VERIFY ALL DIMENSIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO COMMENCING THE WORK. UNLESS OTHERWISE NOTED. 6. ALL DIMENSIONS SHALL BE VERIFY IN FIELD PRIOR TO COMMENCING ANY DEMOLITION. 5. A CIVIL ENGINEER SHOULD BE CONSULTED TO VERIFY FOUNDATION 7. FOR FOUNDATION/SOIL/DRAINAGE SPECIFICATION REFER TO SOIL GEOTECHNICAL REPORT. PLANS AND DETAILS. 8. FOUNDATION PLANS AND PERTINENT DETAILS SHALL BE REVIEWED AND APPROVED BY THE SOILS ENGINEER PRIOR TO ANY FOUNDATION WORK. SOIL REPORT SHALL BE TAKEN PRECEDENCE OVER STRUCTURAL NOTES AND DETAILS. SITE GRADING, SUBGRADE PREPARATION, EXCAVATION, AND PLACEMENT OF ENGINEERED FILL MATERIAL SHALL BE PERFORMED IN ACCORDANCE WITH THE SOIL REPORT AND GRADING PLANS, ALL EXCAVATION AND PLACEMENT OF ENGINEERED FILL SHOULD BE OBSERVED AND APPROVED BY THE SOILS ENGINEER BEFORE PLACEMENT OF REBAR. 9. SURFACE OUTSIDE THE HOUSE NEEDS TO HAVE 5% SLOPE (UNPAVED SURFACE) & 2% SLOPE (PAVED SURFACE) AWAY FROM THE STRUCTURE. 10. ALL FOOTING SIZES AND LOCATIONS TO BE VERIFIED BY A LICENSED STRUCTURAL ENGINEER. 11. CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE. 12. CONTRACTOR TO PROVIDE WATERPROOFING AS REQUIRED TO MEET ALL APPLICABLE CODES AND TYPICAL BUILDING PRACTICES. 13. CONCRETE SLABS TO BE 100MM (3000 PSI MIN.), REINFORCED AS PER CODE OR AS DETERMINED BY LICENSED ENGINEER. 14. CONTRACTOR TO PROVIDE ADEQUATE DRAINAGE BASED ON EXISTING SITE CONDITIONS. VERIFY W/LOCAL CODES. 15. REFER TO FLOOR JOIST MANUFACTURER FOR JOIST SIZING AND SPACING, CROSS BRACING REQUIREMENTS, AND BEAM SIZES. 16. PROVIDE JOISTS UNDER ALL WALLS RUNNING PARALLEL. FF = +100MM 13775 ON-GRADE (3000 PSI) WITH ON-GRADE (3000 PSI) WITH REBAR AS PER ENGG. DWGS. OVER COMPACTED SELECT FILL REBAR AS PER ENGG. DWGS. OVER COMPACTED SELECT FILL FF = +100MM

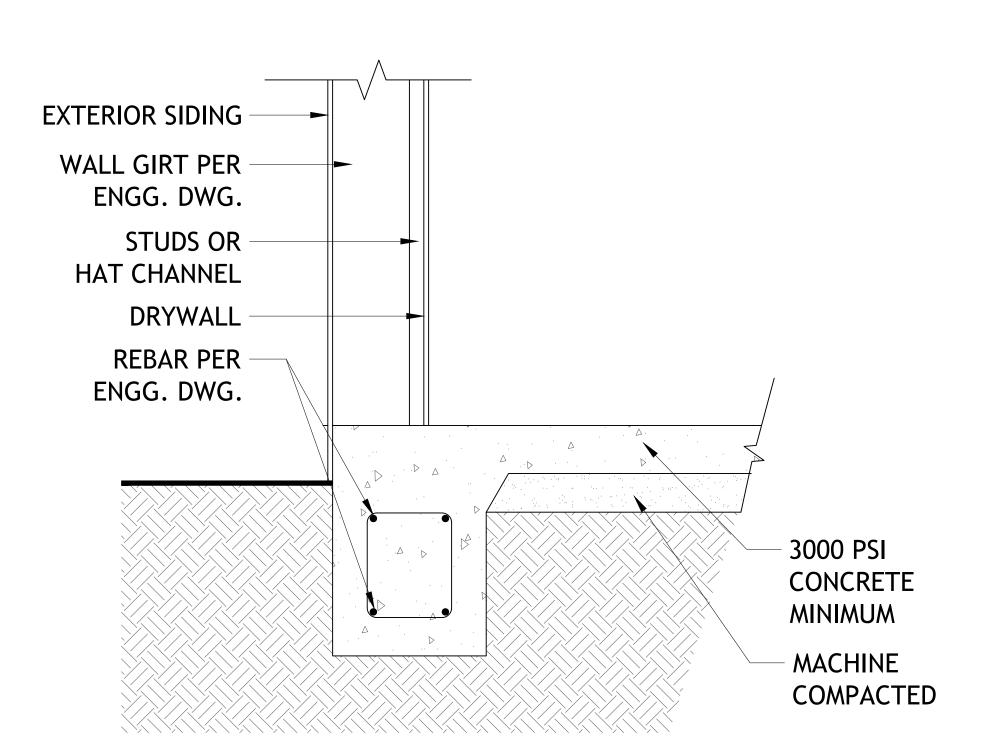




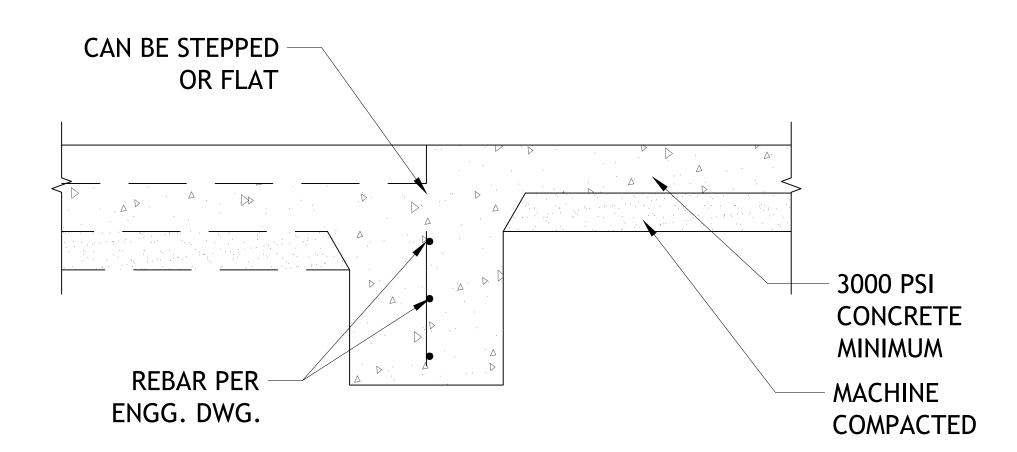

2 INTERIOR BEARING FOOTING
SCALE: 1:10

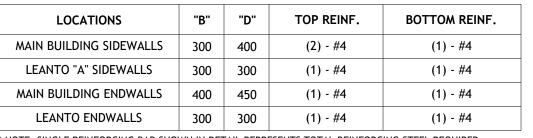

* NOTE: SINGLE REINFORCING BAR SHOWN IN DETAIL REPRESENTS TOTAL REINFORCING STEEL REQUIRED.
SPACE MULTIPLE VARS @ 100MM O.C. MIN.
INSTALL SINGLE TOP REINFORCING BAR (OR FIRST OF MULTIPLE BARS SPECIFIED) AT A DISTANCE

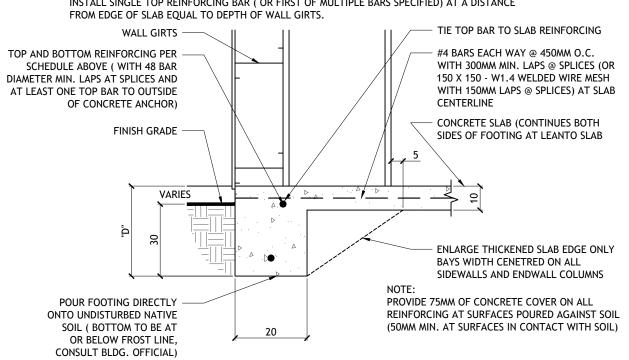


NOTE:

1. SLAB REINFORCING SHOWN ABOVE IS SPECIFIED AS A METHOD OF CONTROLLING SHRINKAGE CRACKING AT THE SLAB SURFACE. CUSTOMER MAY CHOOSE ANOTHER METHOD OR REMOVE SLAB REINFORCING ALL TOGETHER BUT CUSTOMER WILL ASSUME ALL RESPONSIBILITY FOR THE PERFORMANCE OF THE SLAB. IF ANY OTHER METHOD IS CHOSEN BESIDES WHAT IS SHOWN ON THIS DETAIL, CUSTOMER SHALL INSTALL, AT EACH FRAME, (1) #4 CONT. BAR SIDEWALL-TO-SIDEWALL WITH A 150MM 90 HOOK AT EACH END AROUND FRAME COLUMN CONCRETE ANCHOR GROUP.


2. SLAB DESIGN AND REINFORCING SPECIFIED IS BASED SOLELY ON THE SOIL DESIGN PRESSURE INDICATED ON DRAWING SHEET 1 ASSUMING A MAX. POINT (WHEEL) LOAD OF 3000. SLAB DESIGN FOR ANY OTHER SLAB THICKNESS OR POINT LOADS SHALL BE PROVIDED BY OTHERS.

3. SLAB AND FOUNDATION DESIGN SHOWN IS FOR STRUCTURAL PURPOSES ONLY. SLAB DESIGN SHOWN DOES NOT ADDRESS SLAB CONCRETE STRENGTH FOR WEAR RESISTANCE, VAPOR OR MOISTURE BARRIERS, SLAB SUBBASE MATERIAL SPECIFICATIONS OR INSTALLATION METHODS, OR THERMAL (INSULATION) REQUIREMENTS. A QUALIFIED PROFESSIONAL SHOULD BE RETAINED TO PROVIDE GUIDANCE FOR THOSE CONCERNS NOT ADDRESSED ON THIS DETAIL.

5 EDGE OF SLAB DETAIL

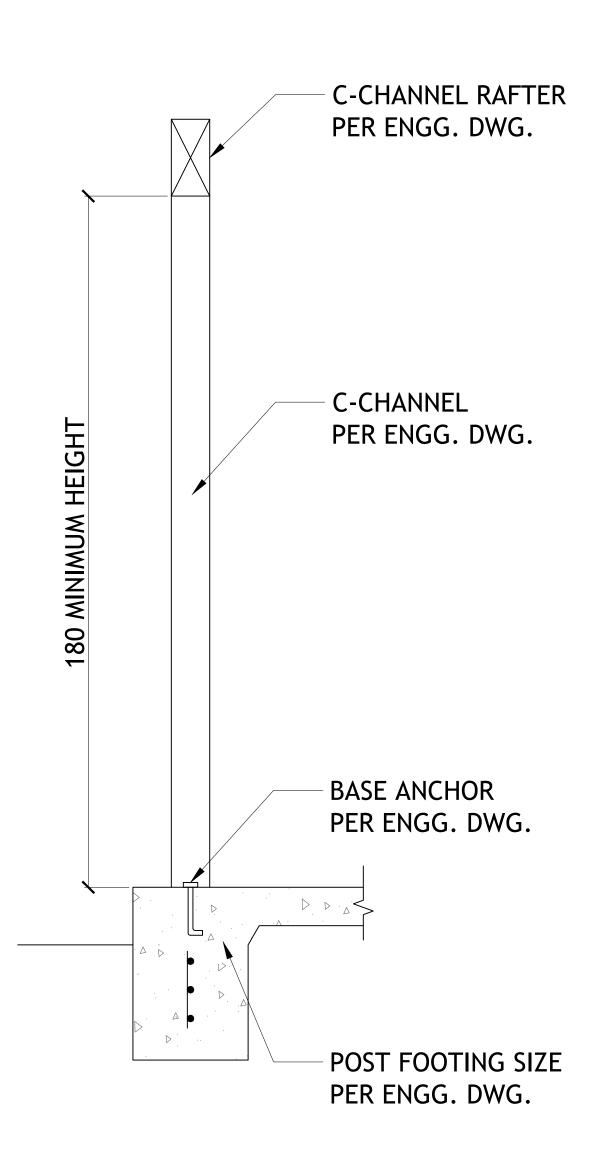

3 C-TYPICAL COLUMN DETAIL
SCALE: 1:10

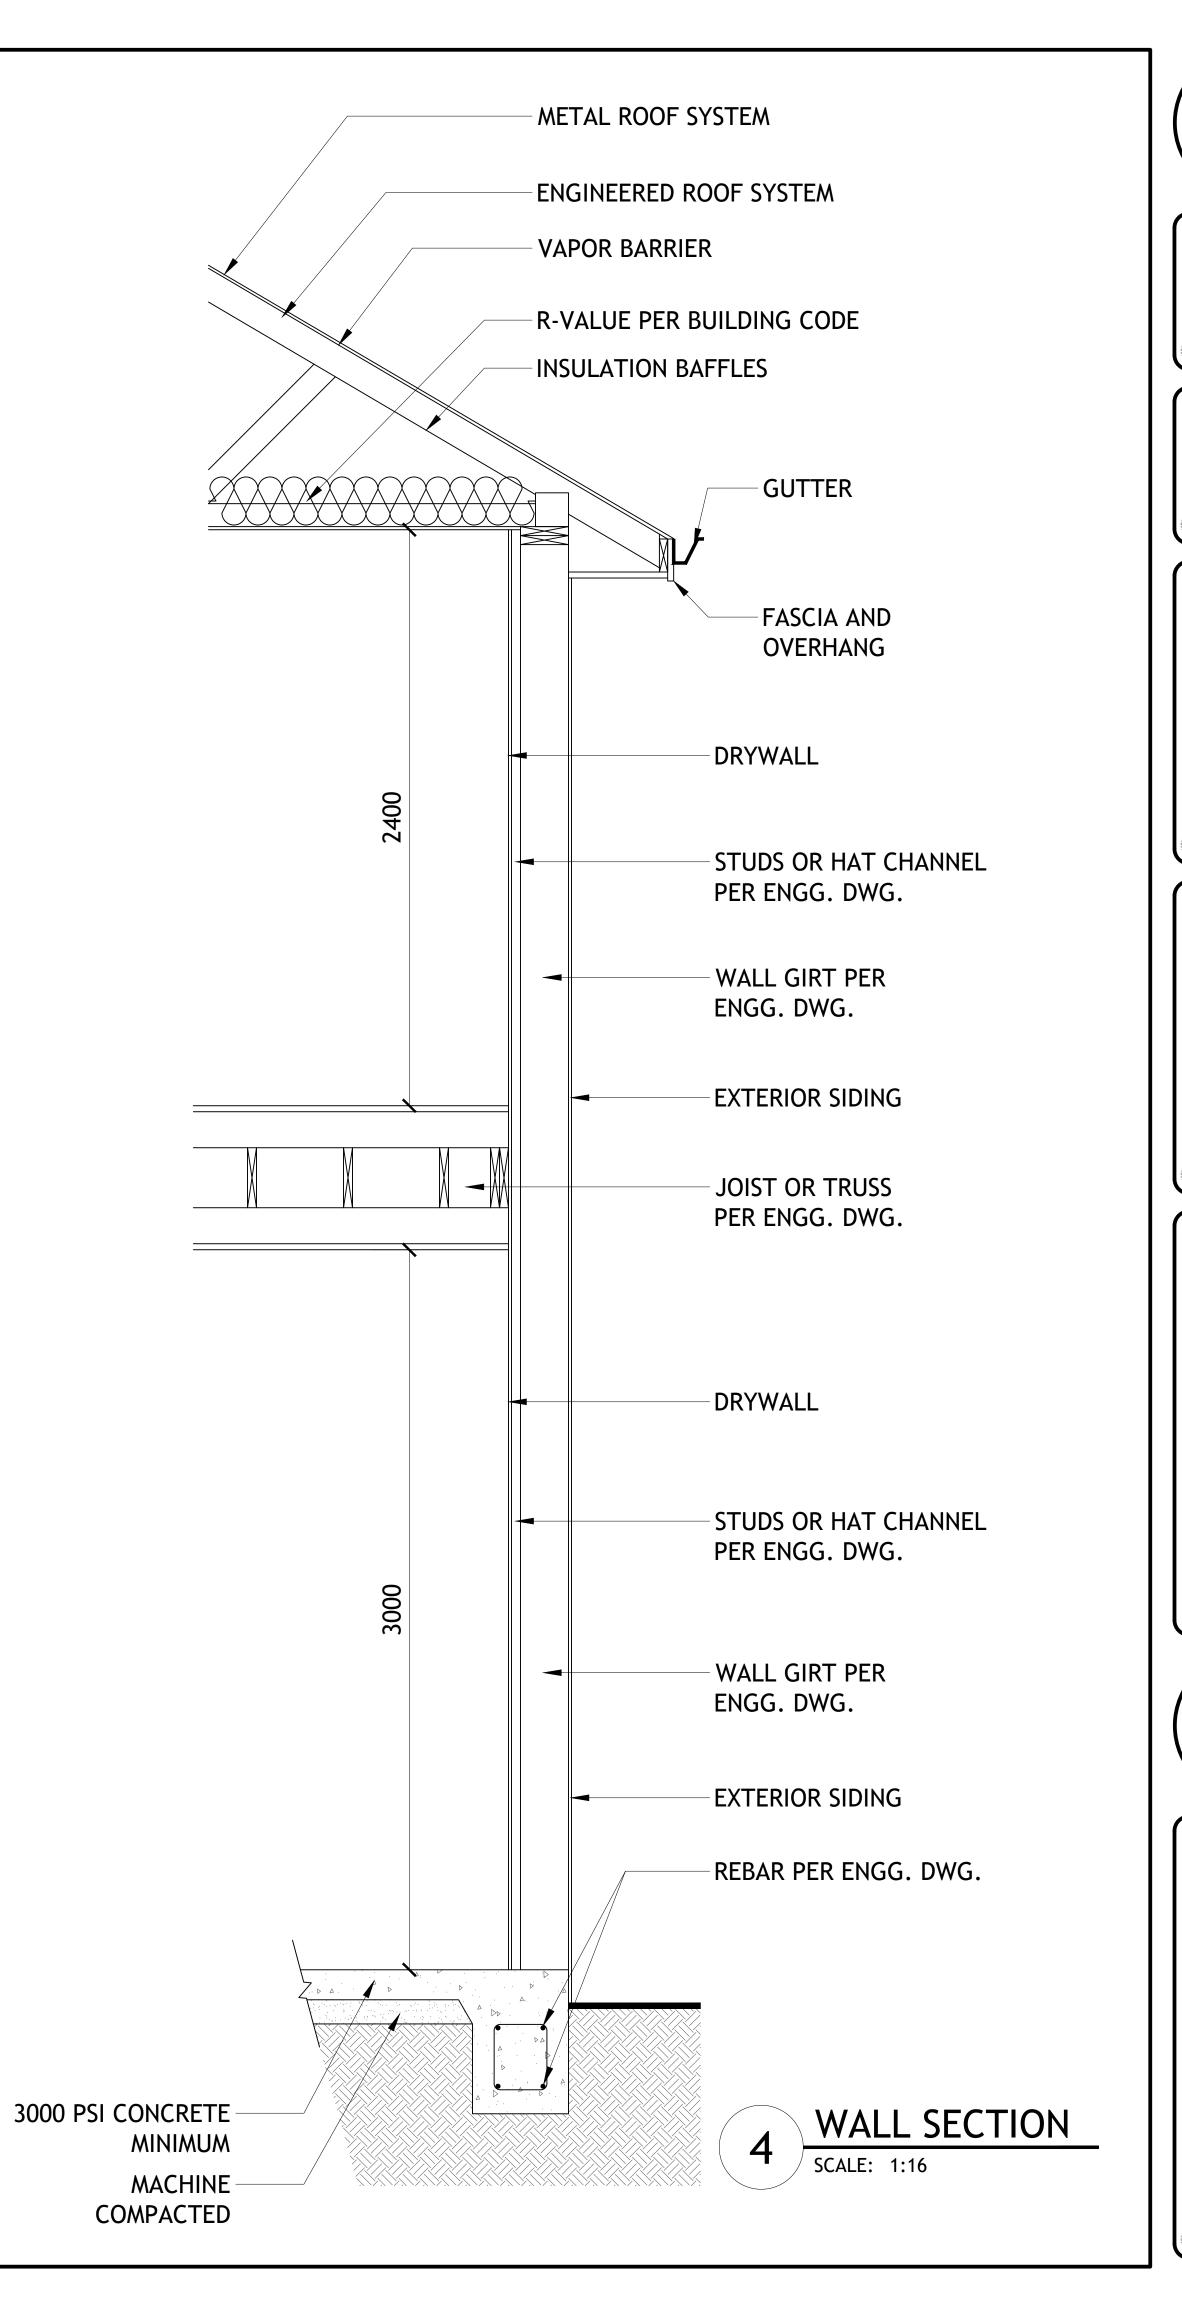

H. Ten